09/00336/PNOT-1

Form B (Type III)

Notes: This Form is for use in connection with an application for the Secretary of State for Energy's consent under **section 37** of the Electricity Act 1989 to install and keep installed above ground an electric line of a nominal voltage of less than 132 kilovolts. The Form should be sent **in triplicate** to each District/Borough Council in whose area the proposed development would be situated.

DETAILS OF APPLICANT
Name: **Central Networks West**
Address: **Pegasus Business Park**
East Midlands Airport
Castle Donington
Postcode: **DE74 2TU**
Telephone Number:01332 393519

PART 1

Central Networks West Application Number **EMP/676** Date **17TH April 2009**
To the Chief Executive **Staffordshire Moorlands District Council** Planning Department

Dear Sir

Electricity Act 1989

Application is being made to the Secretary of State for Energy for his consent to the development described overleaf. The Secretary of State will at the same time be requested to direct that planning permission for this development shall be deemed to be granted. The consent and the direction may be given subject to conditions.

To assist the Secretary of State to determine the application the District/Borough Council is requested to return to me two copies of this Form with Part I Certificate and Part II completed and signed with plans.

Department of the Environment Circular 14/90 (Welsh Office Circular 20/90)[Department of Energy Circular 1/90] describes this procedure and the reason for it.

Yours faithfully
For and on behalf of Central Networks West

Rebecca Harding

Designation: **WAYLEAVES & PROPERTY DEPARTMENT**

CERTIFICATE

(To be completed by or on behalf of the District/Borough Council)

The District/Borough Council

(i) object on the grounds set out below/have no objection to make to the development described overleaf.*

(ii) request/do not request that a public inquiry be held pursuant to paragraph 2 of Schedule 8 to the Electricity Act 1989 before the Secretary of State reaches his decision on the application.*

Date Signed

* Delete as appropriate Designation

On behalf of the District/Borough Council

(Reasons for objections)

Central Networks West Application Number
EMP/676
(Application dated)

PART II - INFORMATION AND OBSERVATION

(To be completed by the District/Borough Council)

Planning Reference Number _____

1. Names of interested parties consulted about the proposals with details of any observations received.

2. Particulars of any representations which have been made to the local planning authority objecting to the proposals.

3. Have any general or specific restrictions been imposed by any authority on development of the land affected by the proposed development?

Unspecified User
1:5000 SJ937552
09/04/2009 12:42:09

IMPORTANT WARNING-THIS PLAN IS FURNISHED AS A GENERAL GUIDE ONLY. IT MUST NOT BE RELIED UPON IN THE EVENT OF EXCAVATIONS OR OTHER WORKS CARRIED OUT IN THE VICINITY OF CENTRAL NETWORKS CABLES AND ASSOCIATED PLANT. CABLES AND PLANT MAY BE SOME DISTANCE FROM THEIR APPARENT POSITIONS ON THE PLAN. A LINE MAY INDICATE THE PRESENCE OF MORE THAN ONE CABLE - SEE TRENCH SECTION FOR DETAILS. NOT ALL SERVICE CABLES ARE SHOWN. THERE MAY BE CABLES AND PLANT OWNED BY OTHERS IN THE VICINITY WHICH ARE NOT SHOWN. CABLES SHOWN DEAD OR DISCONNECTED ON THIS PLAN MAY HAVE BEEN RECONNECTED AND SHOULD BE TREATED AS LIVE. MORE DETAILED INFORMATION MAY BE AVAILABLE FOR 33KV, 66KV AND 132KV CABLES IF REQUIRED. THIS PRINT IS ONLY VALID FOR 3 MONTHS FROM THE DATE STAMP.

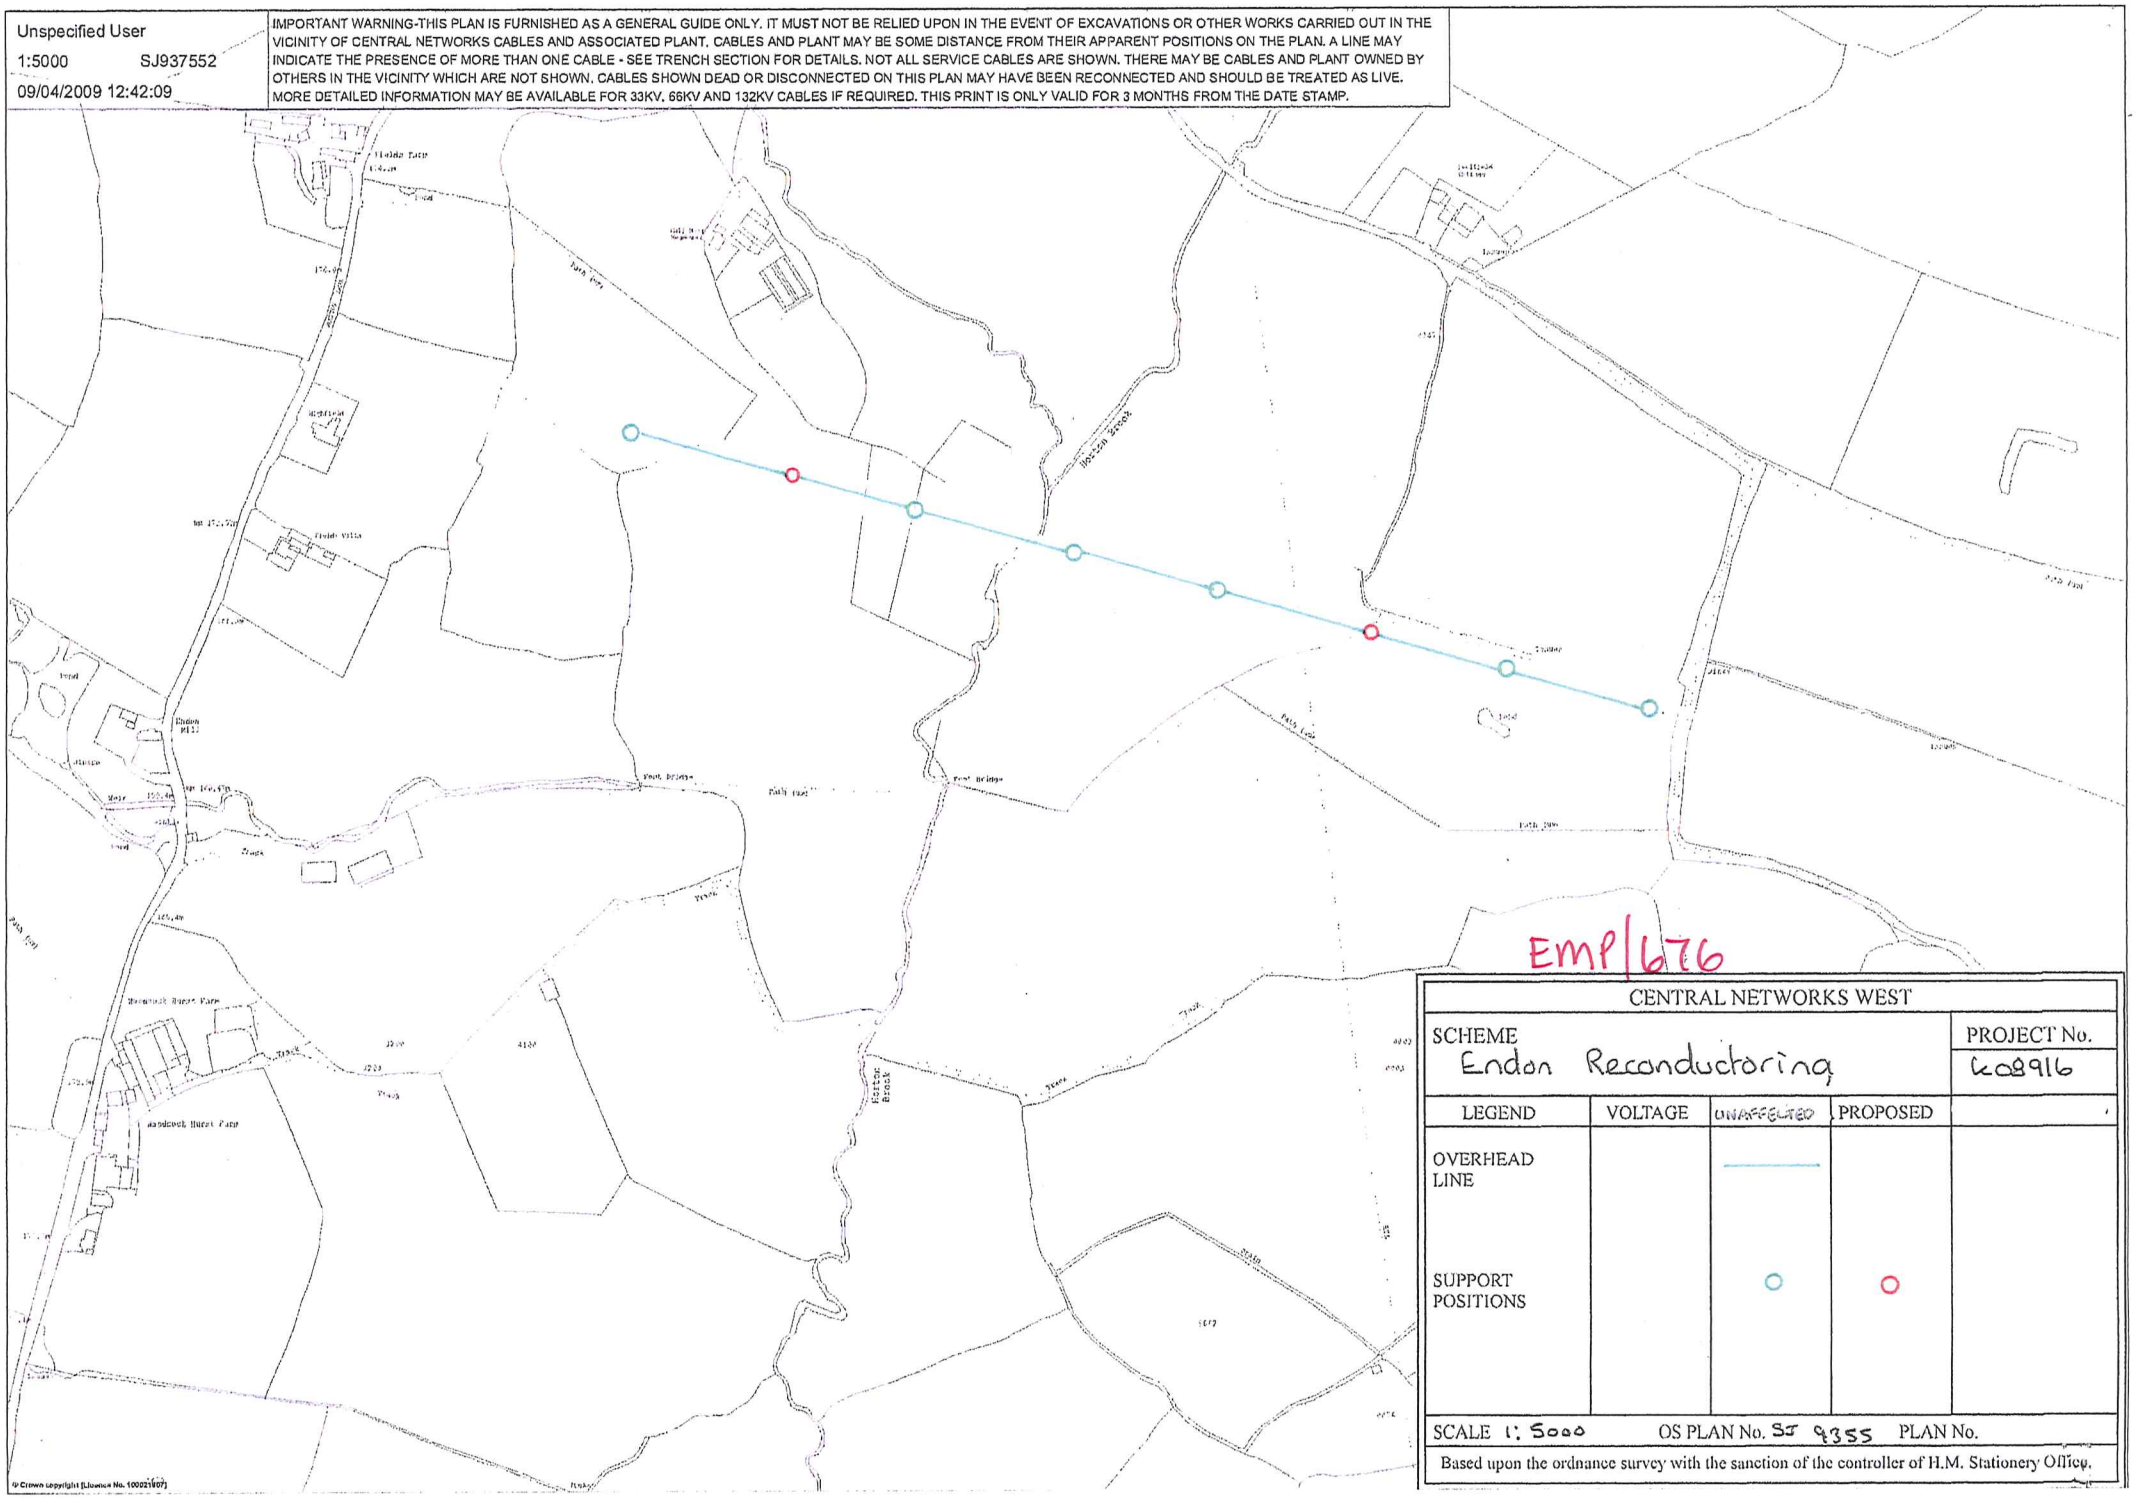

© Crown copyright [Licence No. 100021607]

EMP/676

CENTRAL NETWORKS WEST

SCHEME	PROJECT No.
Endon Reconductoring	608916

LEGEND	VOLTAGE	UNAFFECTED	PROPOSED	
OVERHEAD LINE				
SUPPORT POSITIONS				

SCALE 1: 5000 OS PLAN No. SJ 9355 PLAN No.

Based upon the ordnance survey with the sanction of the controller of H.M. Stationery Office.

Unspecified User
1:5000 | SJ950526
09/04/2009 12:09:40

IMPORTANT WARNING-THIS PLAN IS FURNISHED AS A GENERAL GUIDE ONLY. IT MUST NOT BE RELIED UPON IN THE EVENT OF EXCAVATIONS OR OTHER WORKS CARRIED OUT IN THE VICINITY OF CENTRAL NETWORKS CABLES AND ASSOCIATED PLANT. CABLES AND PLANT MAY BE SOME DISTANCE FROM THEIR APPARENT POSITIONS ON THE PLAN. A LINE MAY INDICATE THE PRESENCE OF MORE THAN ONE CABLE - SEE TRENCH SECTION FOR DETAILS. NOT ALL SERVICE CABLES ARE SHOWN. THERE MAY BE CABLES AND PLANT OWNED BY OTHERS IN THE VICINITY WHICH ARE NOT SHOWN. CABLES SHOWN DEAD OR DISCONNECTED ON THIS PLAN MAY HAVE BEEN RECONNECTED AND SHOULD BE TREATED AS LIVE. MORE DETAILED INFORMATION MAY BE AVAILABLE FOR 33KV, 66KV AND 132KV CABLES IF REQUIRED. THIS PRINT IS ONLY VALID FOR 3 MONTHS FROM THE DATE STAMP.

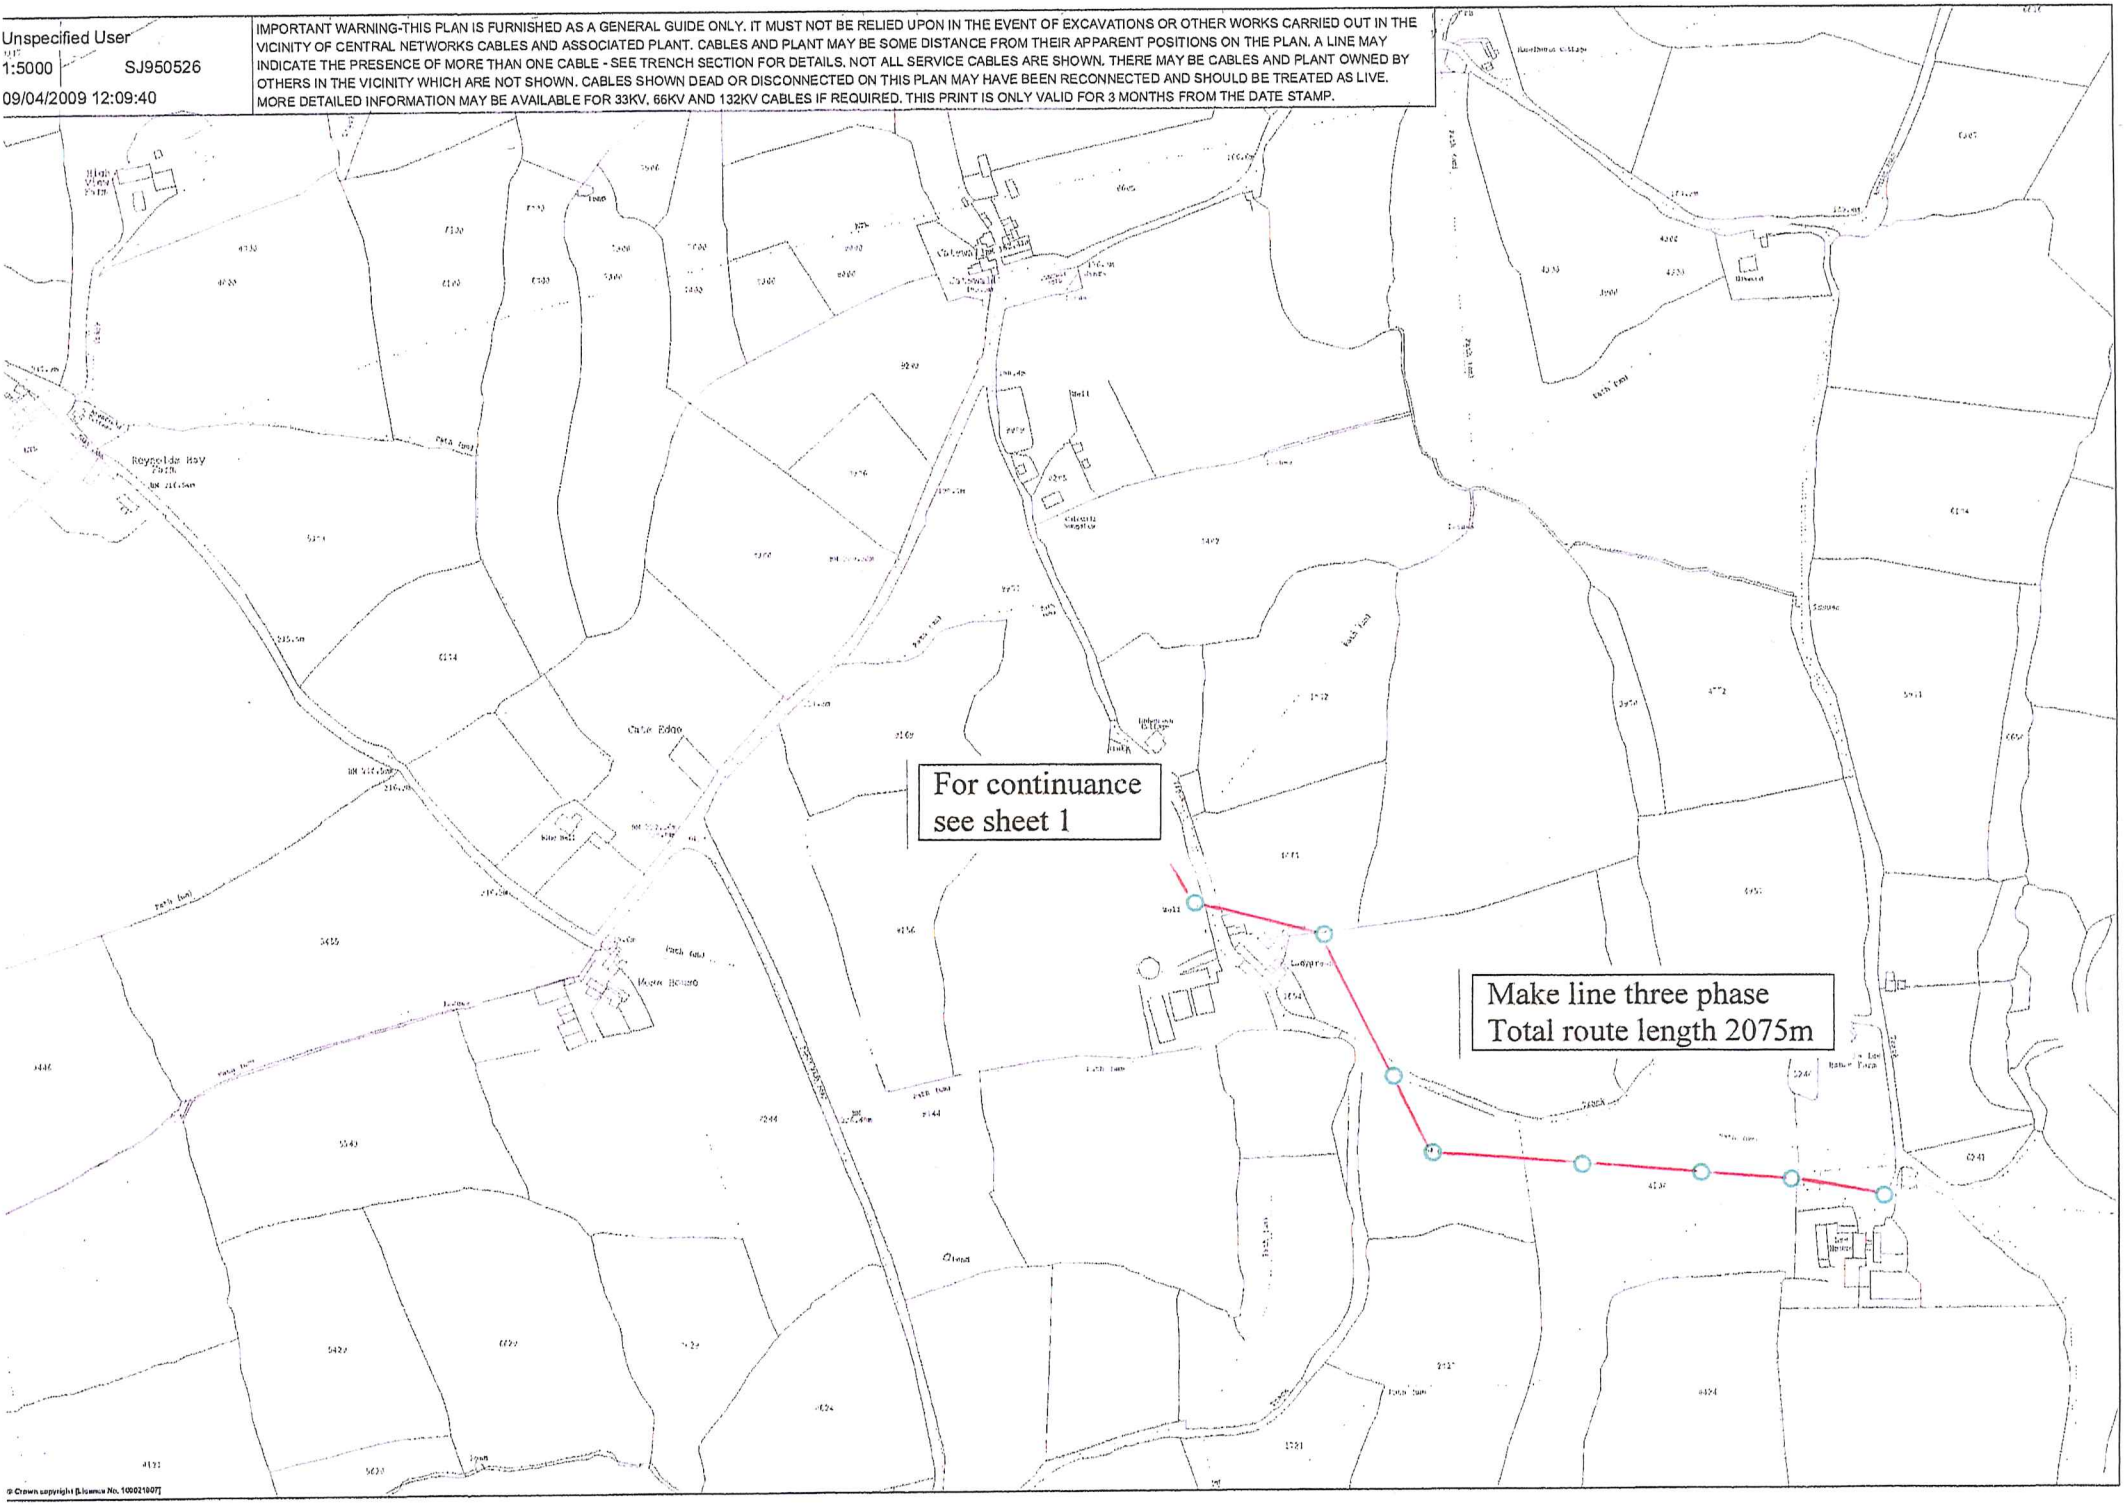

© Crown copyright [Licence No. 100021807]