
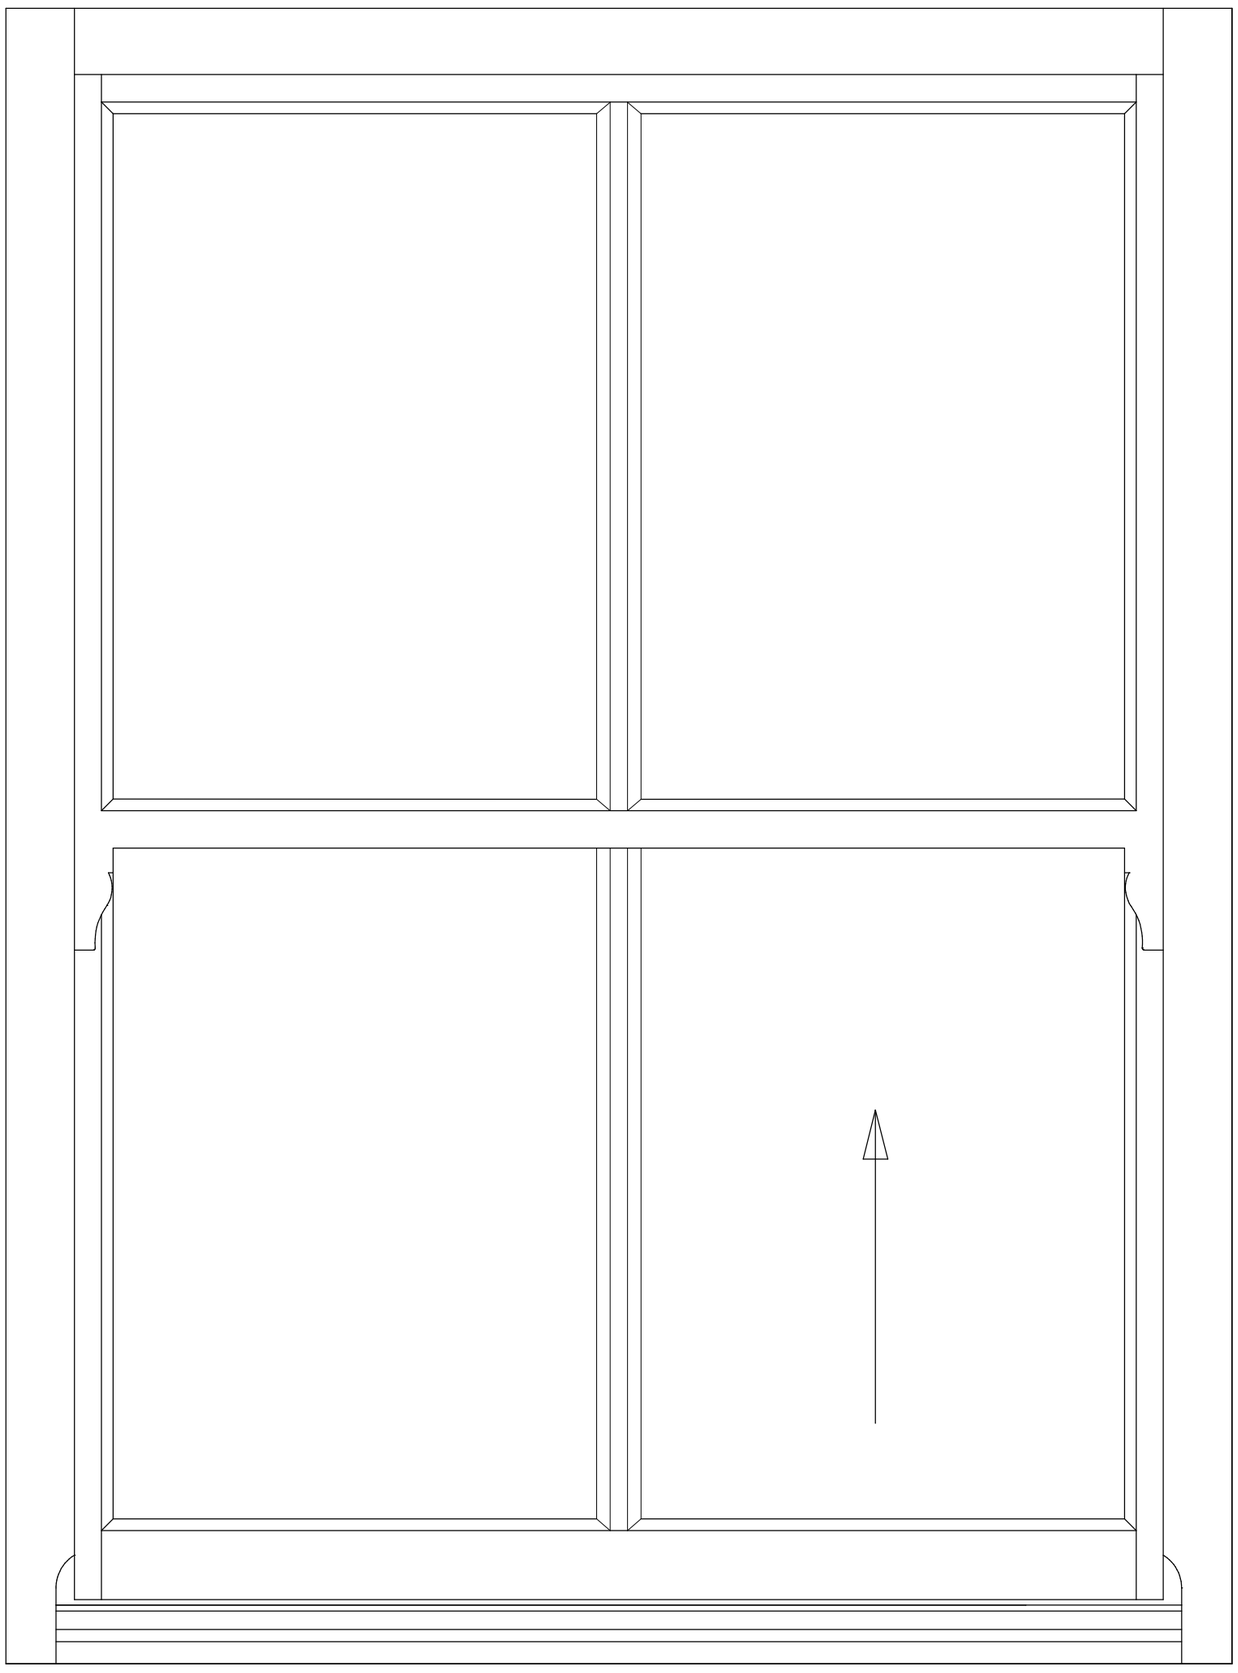


WINDOW ELEVATION

SCALE 1:5

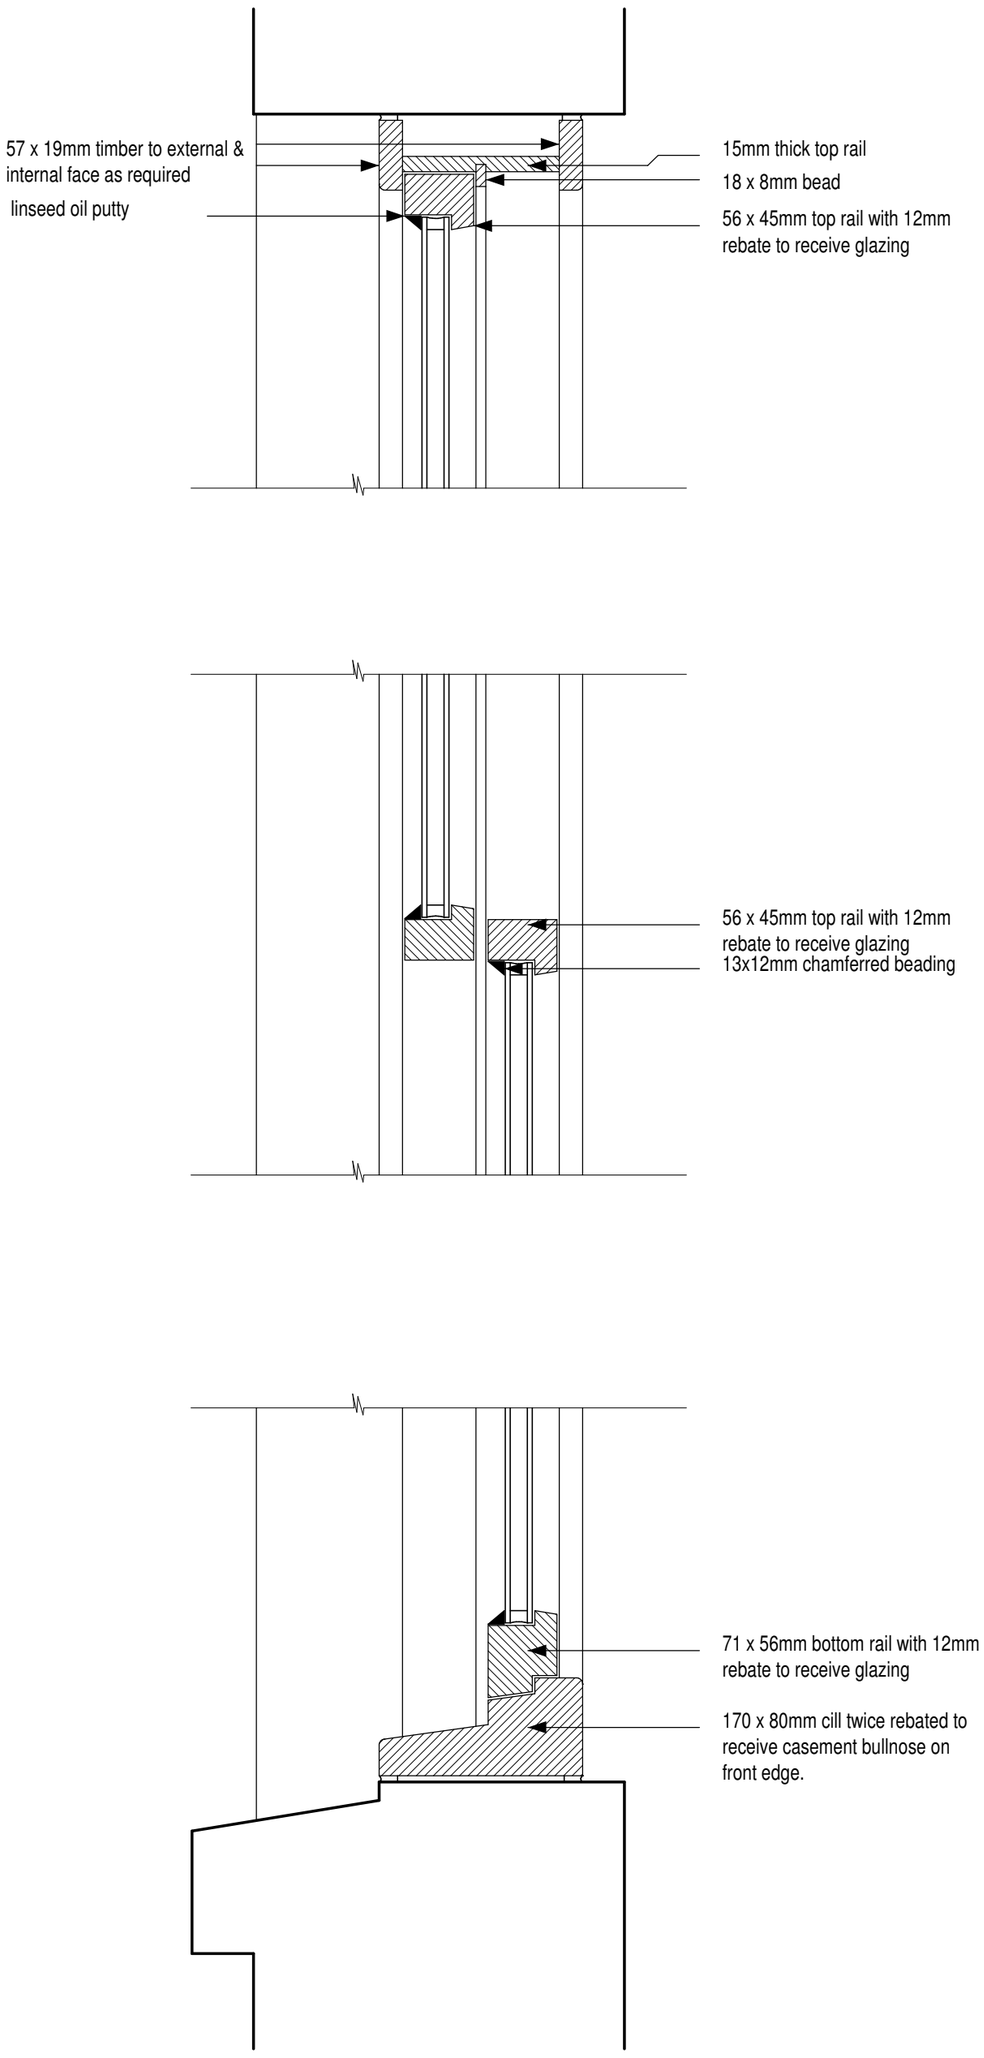

WINDOW SECTION

SCALE 1:5


NOTES:-
All window sizes shall be measured on site by the manufacturer prior to manufacture.

Sliding sash slim-line (spiral balance)

All opening casements to be fitted with draught proofing.

Paint in a colour to match the existing windows.

WINDOWS (max 'U' value 1.6W/m²K)
All double glazed to domestic rooms utilising low-E glass
Manufacturers certified 'U' values must be obtained and passed onto L.A. Building Inspector for approval.
Ventilation openings shall exceed 1/20th floor area of the room served and be be fitted with draught stripping.
Provide 8000mm² adjustable trickle vents to all habitable and bed rooms;
Silicone mastic sealant shall be applied internally and externally around all openings.

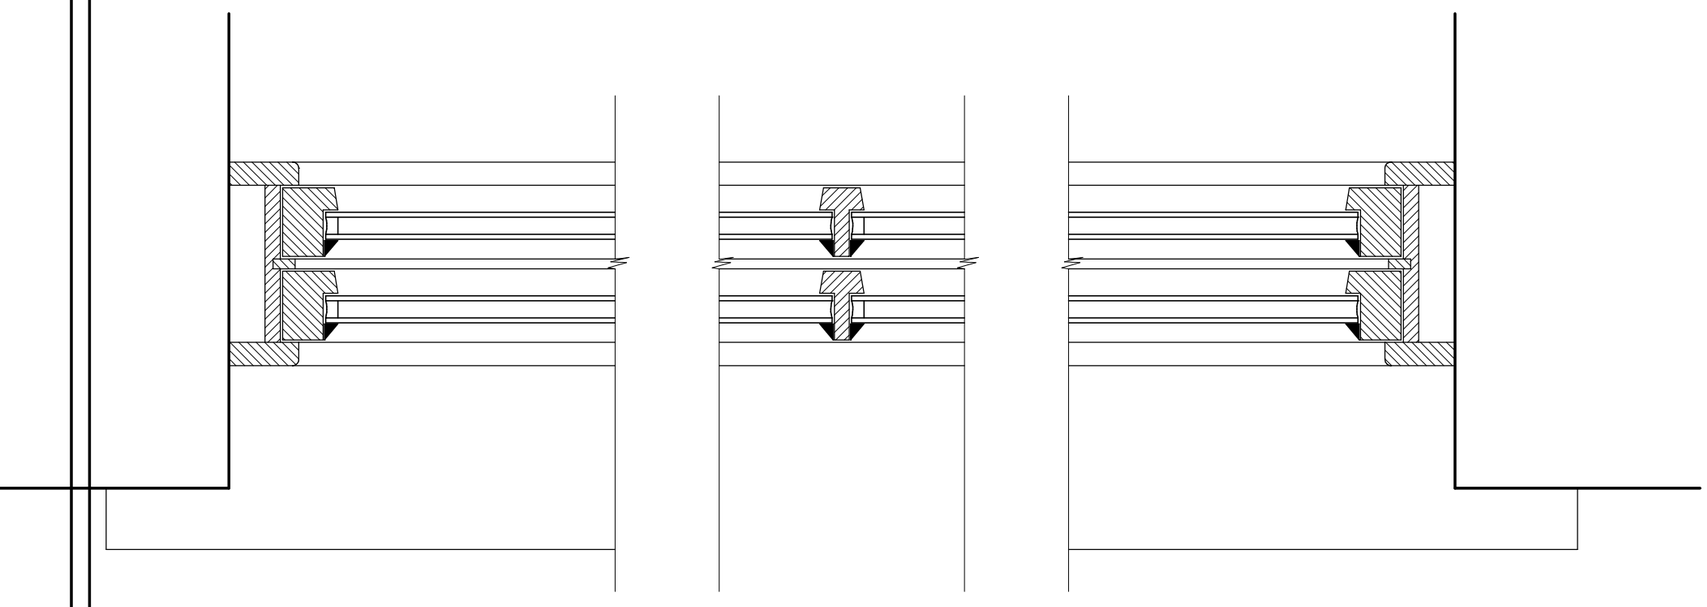

WINDOW PLAN

SCALE 1:5

0.0mm 100mm 200mm 300mm

scale bar @ 1:5

Edith Shaw Care Centre

PROPOSED 1 STOREY EXTENSION TO
EDITH SHAW CARE CENTRE,
HUGO STREET,
LEEK,
STAFFS, ST13 5PE.

PLANNING PROPOSAL
SASH WINDOW DETAIL

Date	Sheet	Scale
JULY 2019	A2	1:5
Drg No.	Rev.	Drawn
2018-2345-15	A	NAW

A - 01/05/2019 - NOTE AMENDED FOLLOWING PLANNING FEEDBACK

SAMMONS Architectural LIMITED
Chartered Institute of Architectural Technologists Registered Practice
10 Cawdry Buildings, Fountain Street, Leek. ST13 6JP
Telephone: 01538 386002
E-mail: info@sammonsltd.co.uk
Web: www.sammonsltd.co.uk

This drawing is copyright.
All dimensions must be checked prior to commencement.