



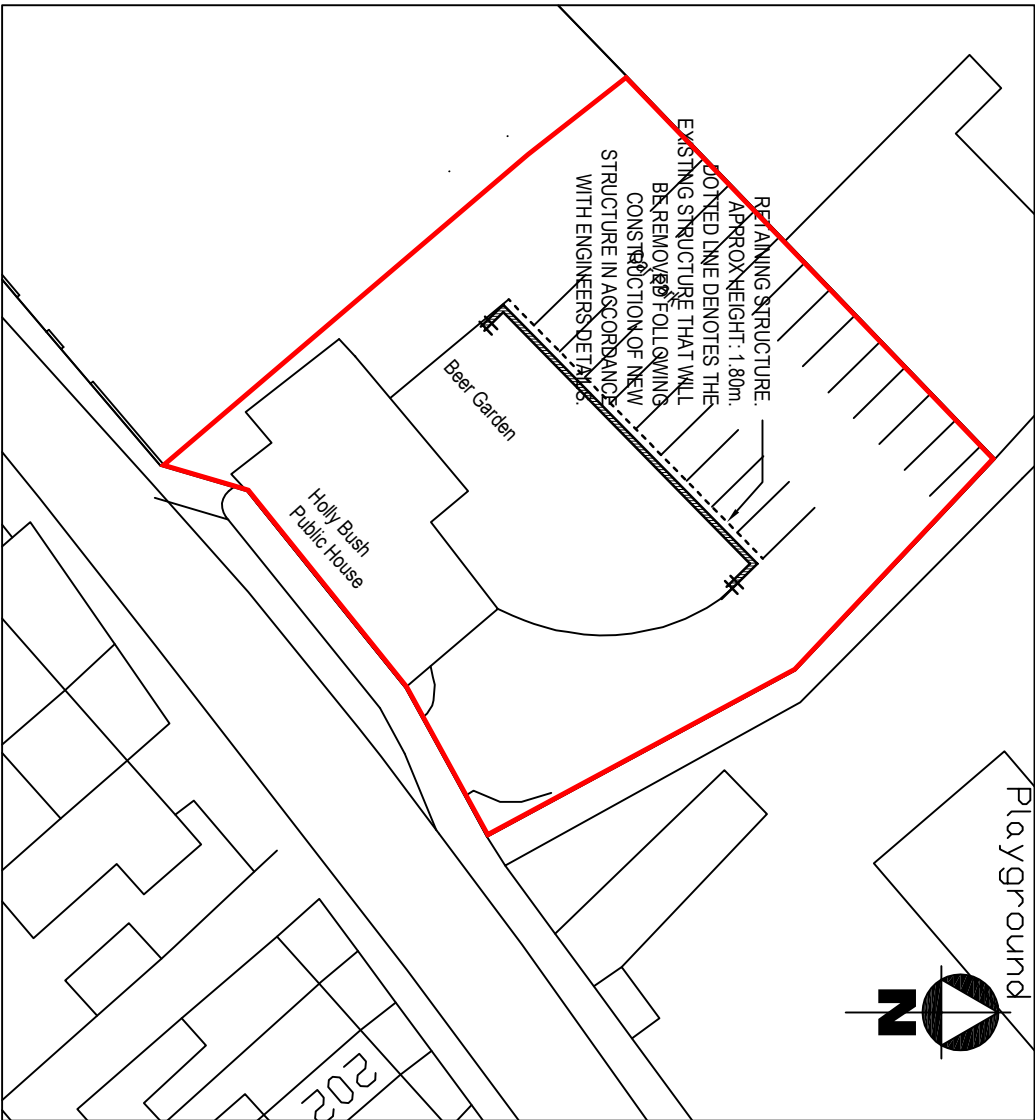

SITE PLAN (SCALE 1:500)

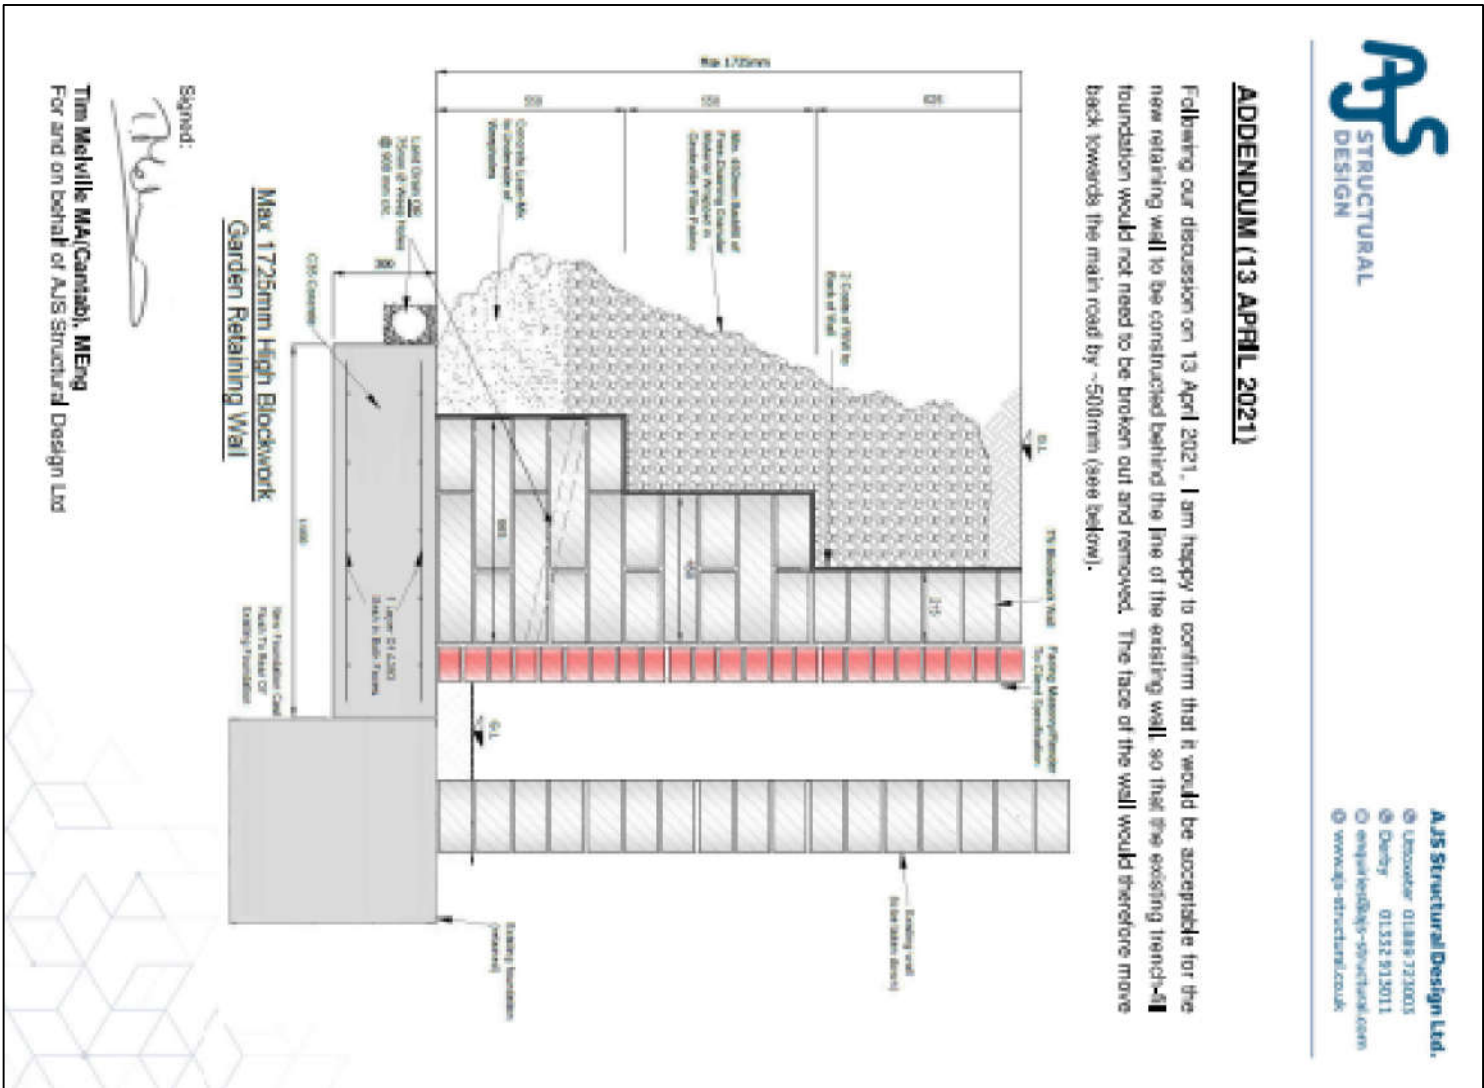


ADDENDUM (13 APRIL 2021)

Following our discussion on 13 April 2021, I am happy to confirm that it would be acceptable for the new retaining wall to be constructed behind the line of the existing wall so that the existing foundation would not need to be broken out and removed. The base of the wall would therefore move back towards the main road by ~500mm (see below).


AJS
STRUCTURAL
DESIGN

AJS Structural Design Ltd.
© Liscower 01488 723003
© Dwyer 01232 912011
© enquiry@ajs-structural.com
© www.ajs-structural.co.uk


ORIGINAL NORTH WEST ELEVATION FROM CAR PARK

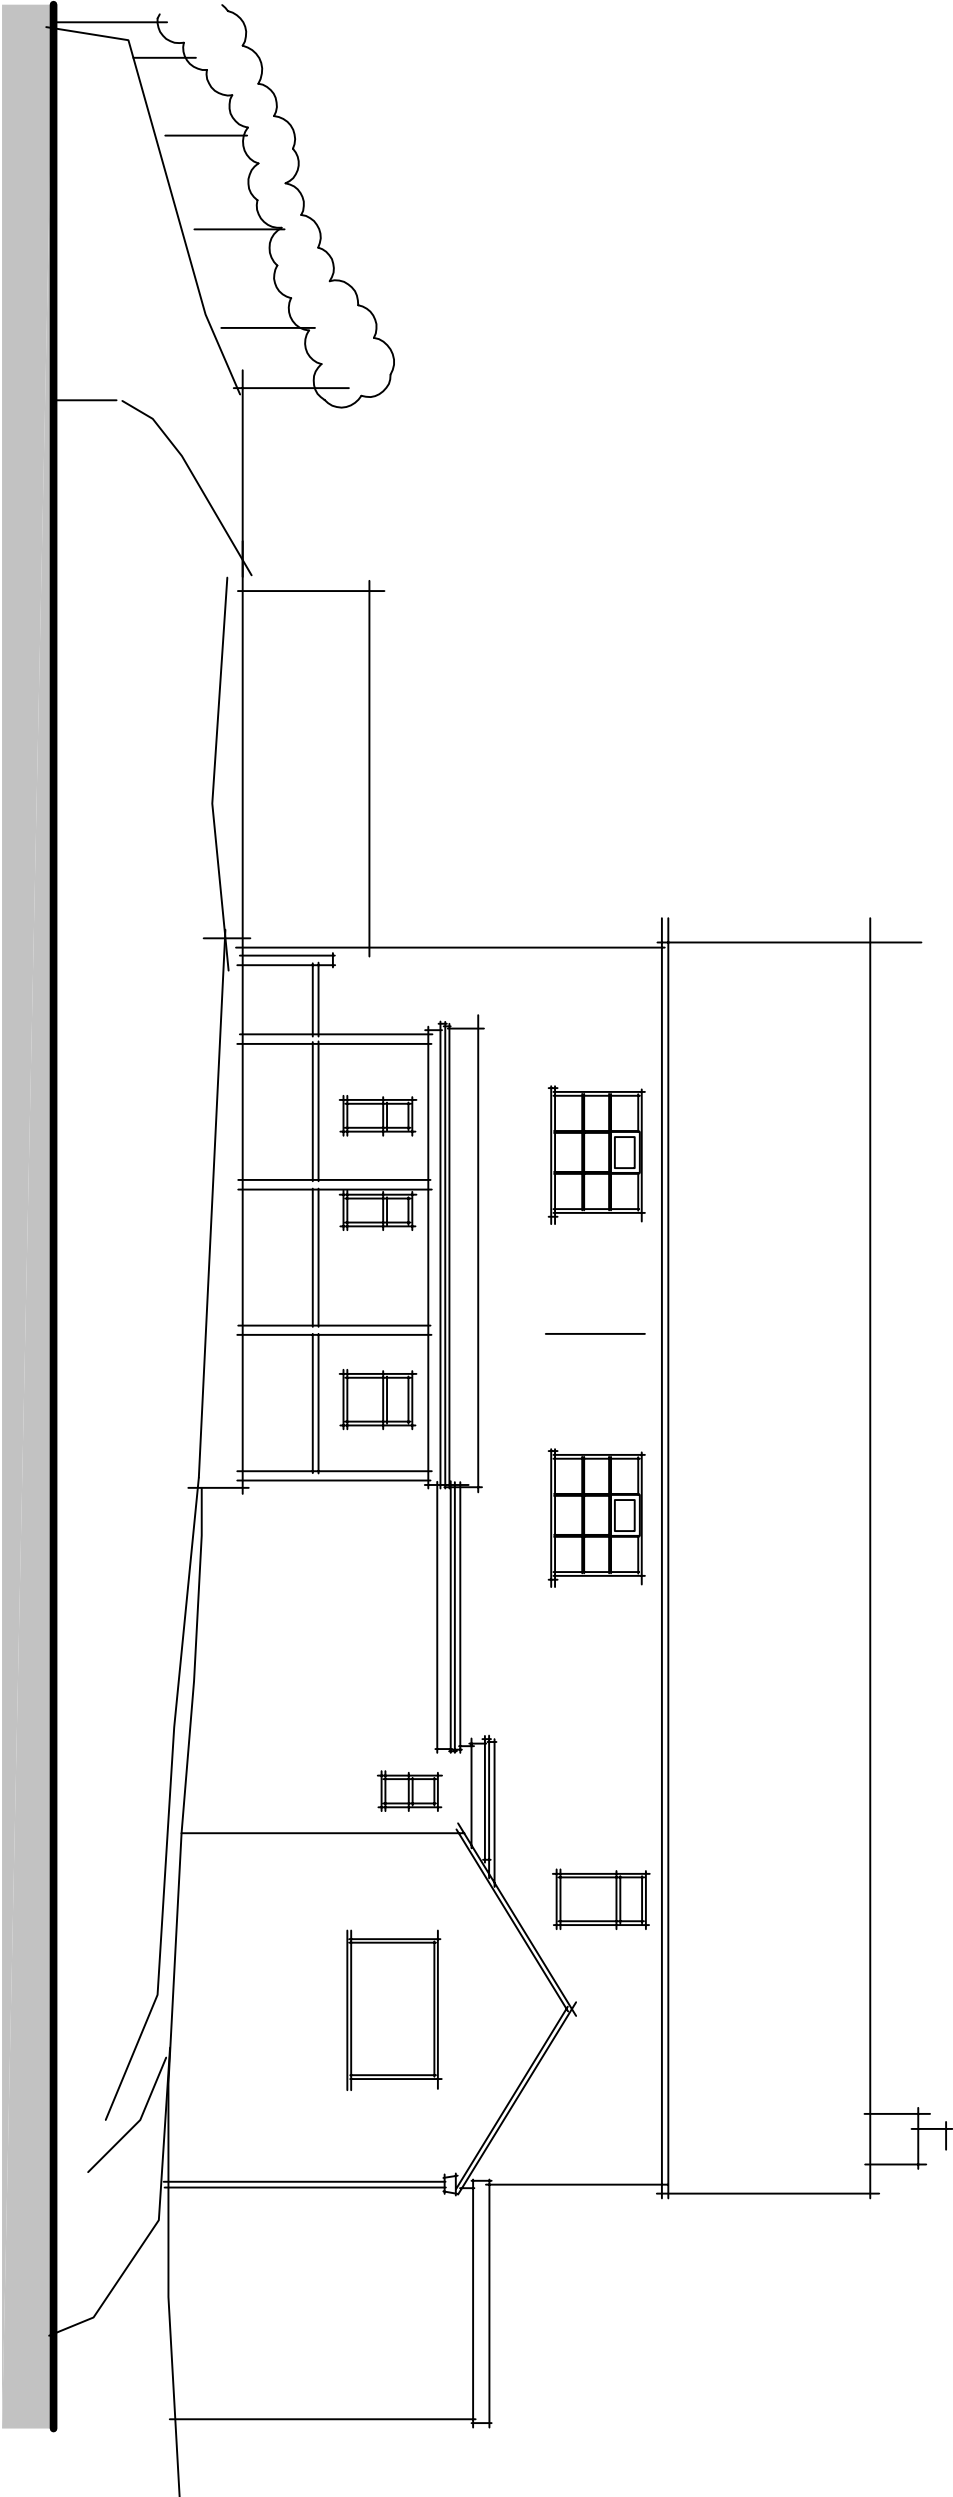

RETAINING WALL NORTH EAST ELEVATION

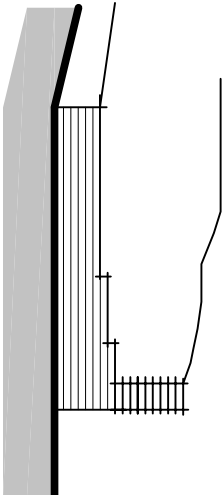

RETAINING WALL NORTH WEST ELEVATION FROM CAR PARK

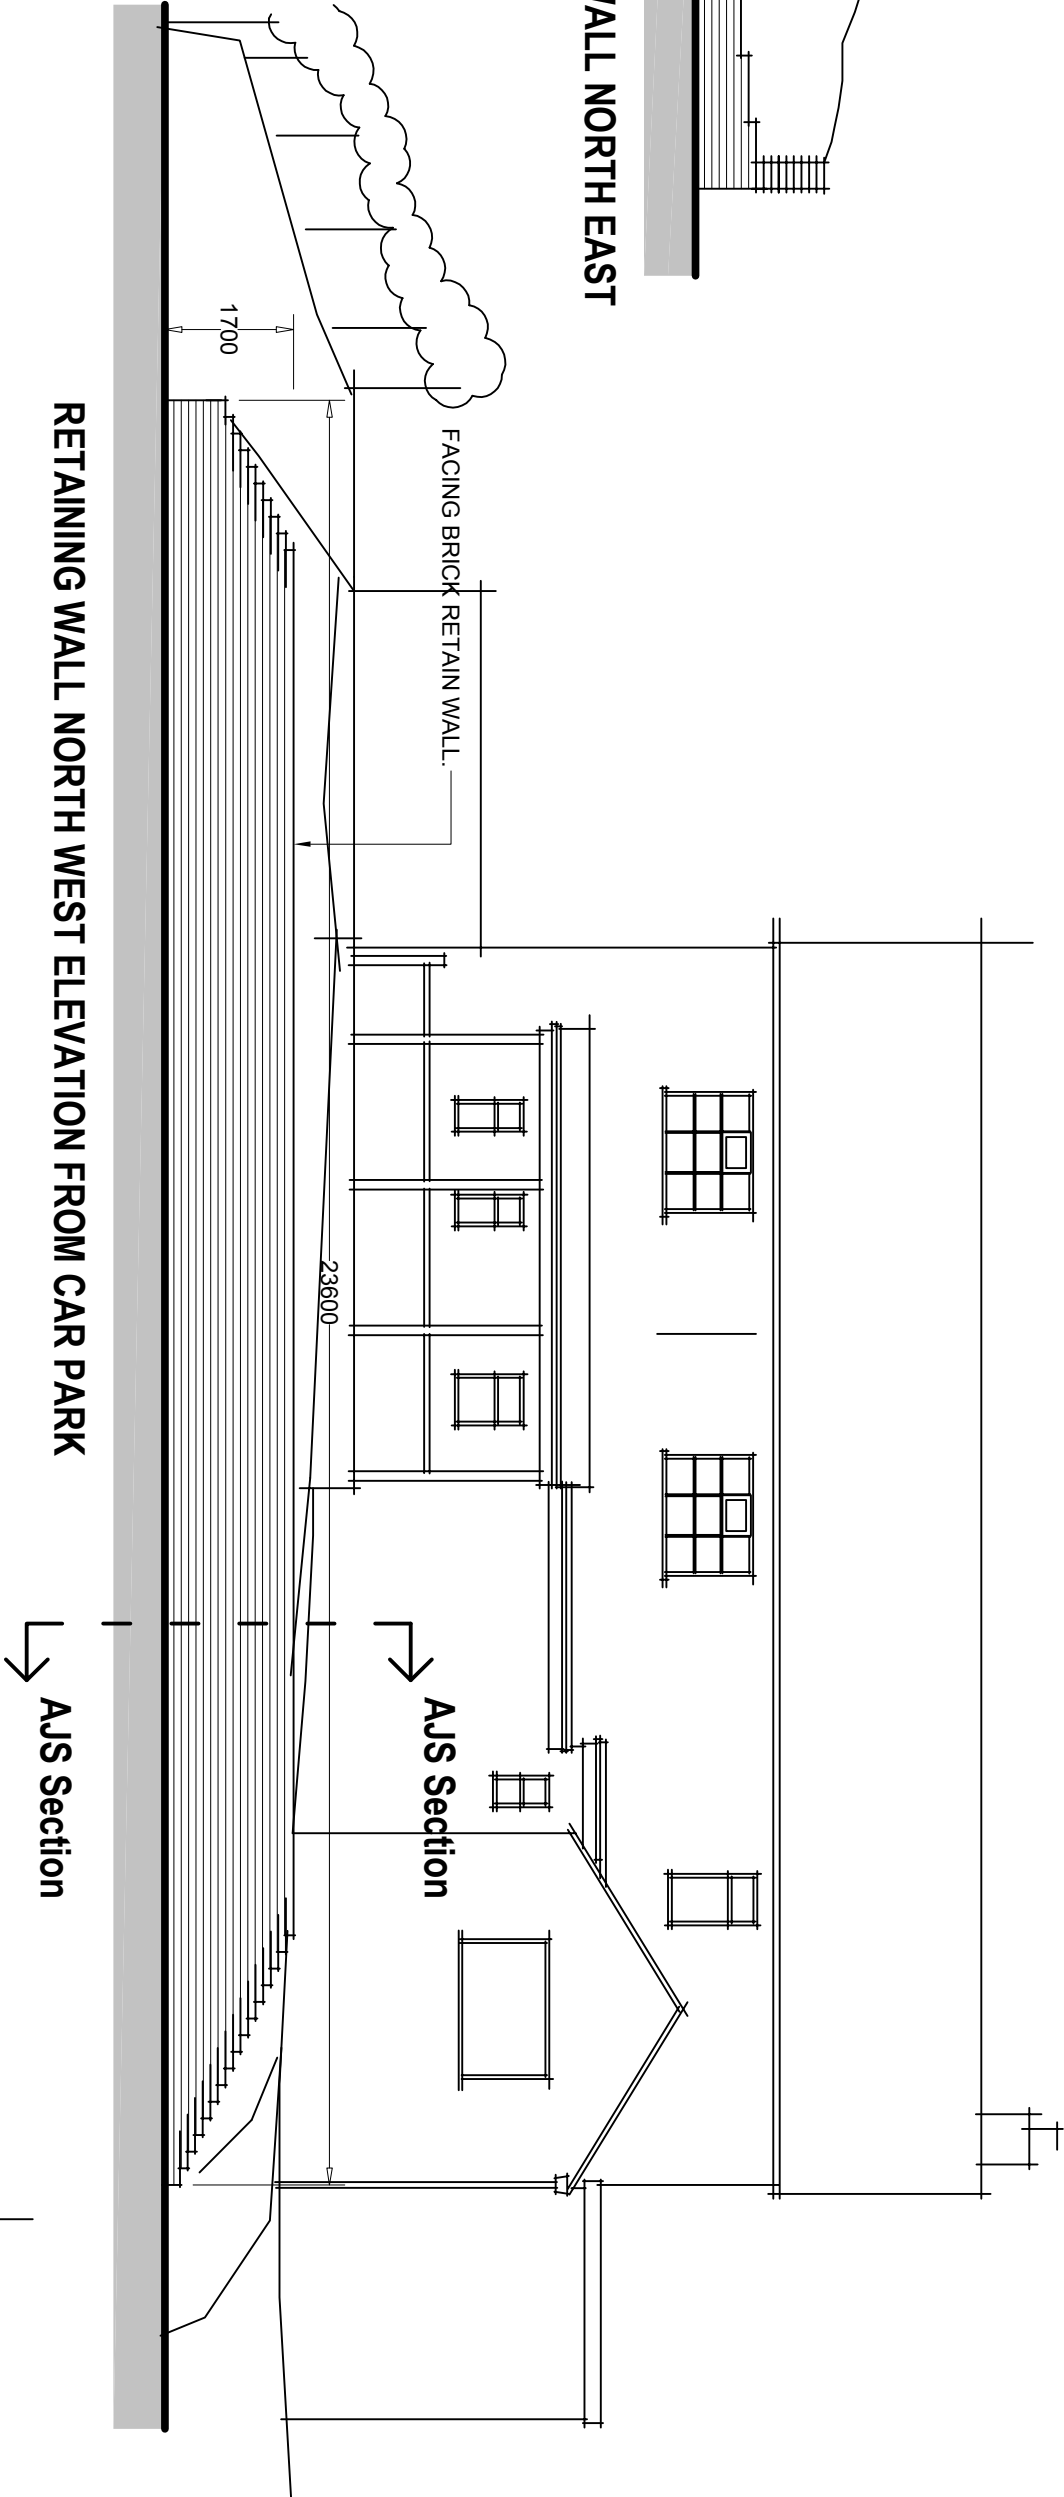

AJS STRUCTURAL DESIGN
APPROVED DRAWING
(SEE REPORT FOR FURTHER DETAILS)

A (13.04.21): AJS recommended retaining wall section added to drawing.		Rev:			
Project:		Planning Submission Retaining Wall, at:			
Site:		High Lane, Brown Edge Stoke on Trent, Staffs.			
Title:		Proposed Elevation & Site Plan.			
Client:		Gowar Group LLP, St Matthews Business Centre, Gowar Street, Leicester, LE1 3LL.			
Date:	Scale:	Drawing No:	Rev:		
February 2021	1:100, 1:500 & 1:1250 @ A2	1399/ A2/01	1		