


Proposed New Domestic Access Crossing
123 High lane
Brown Edge

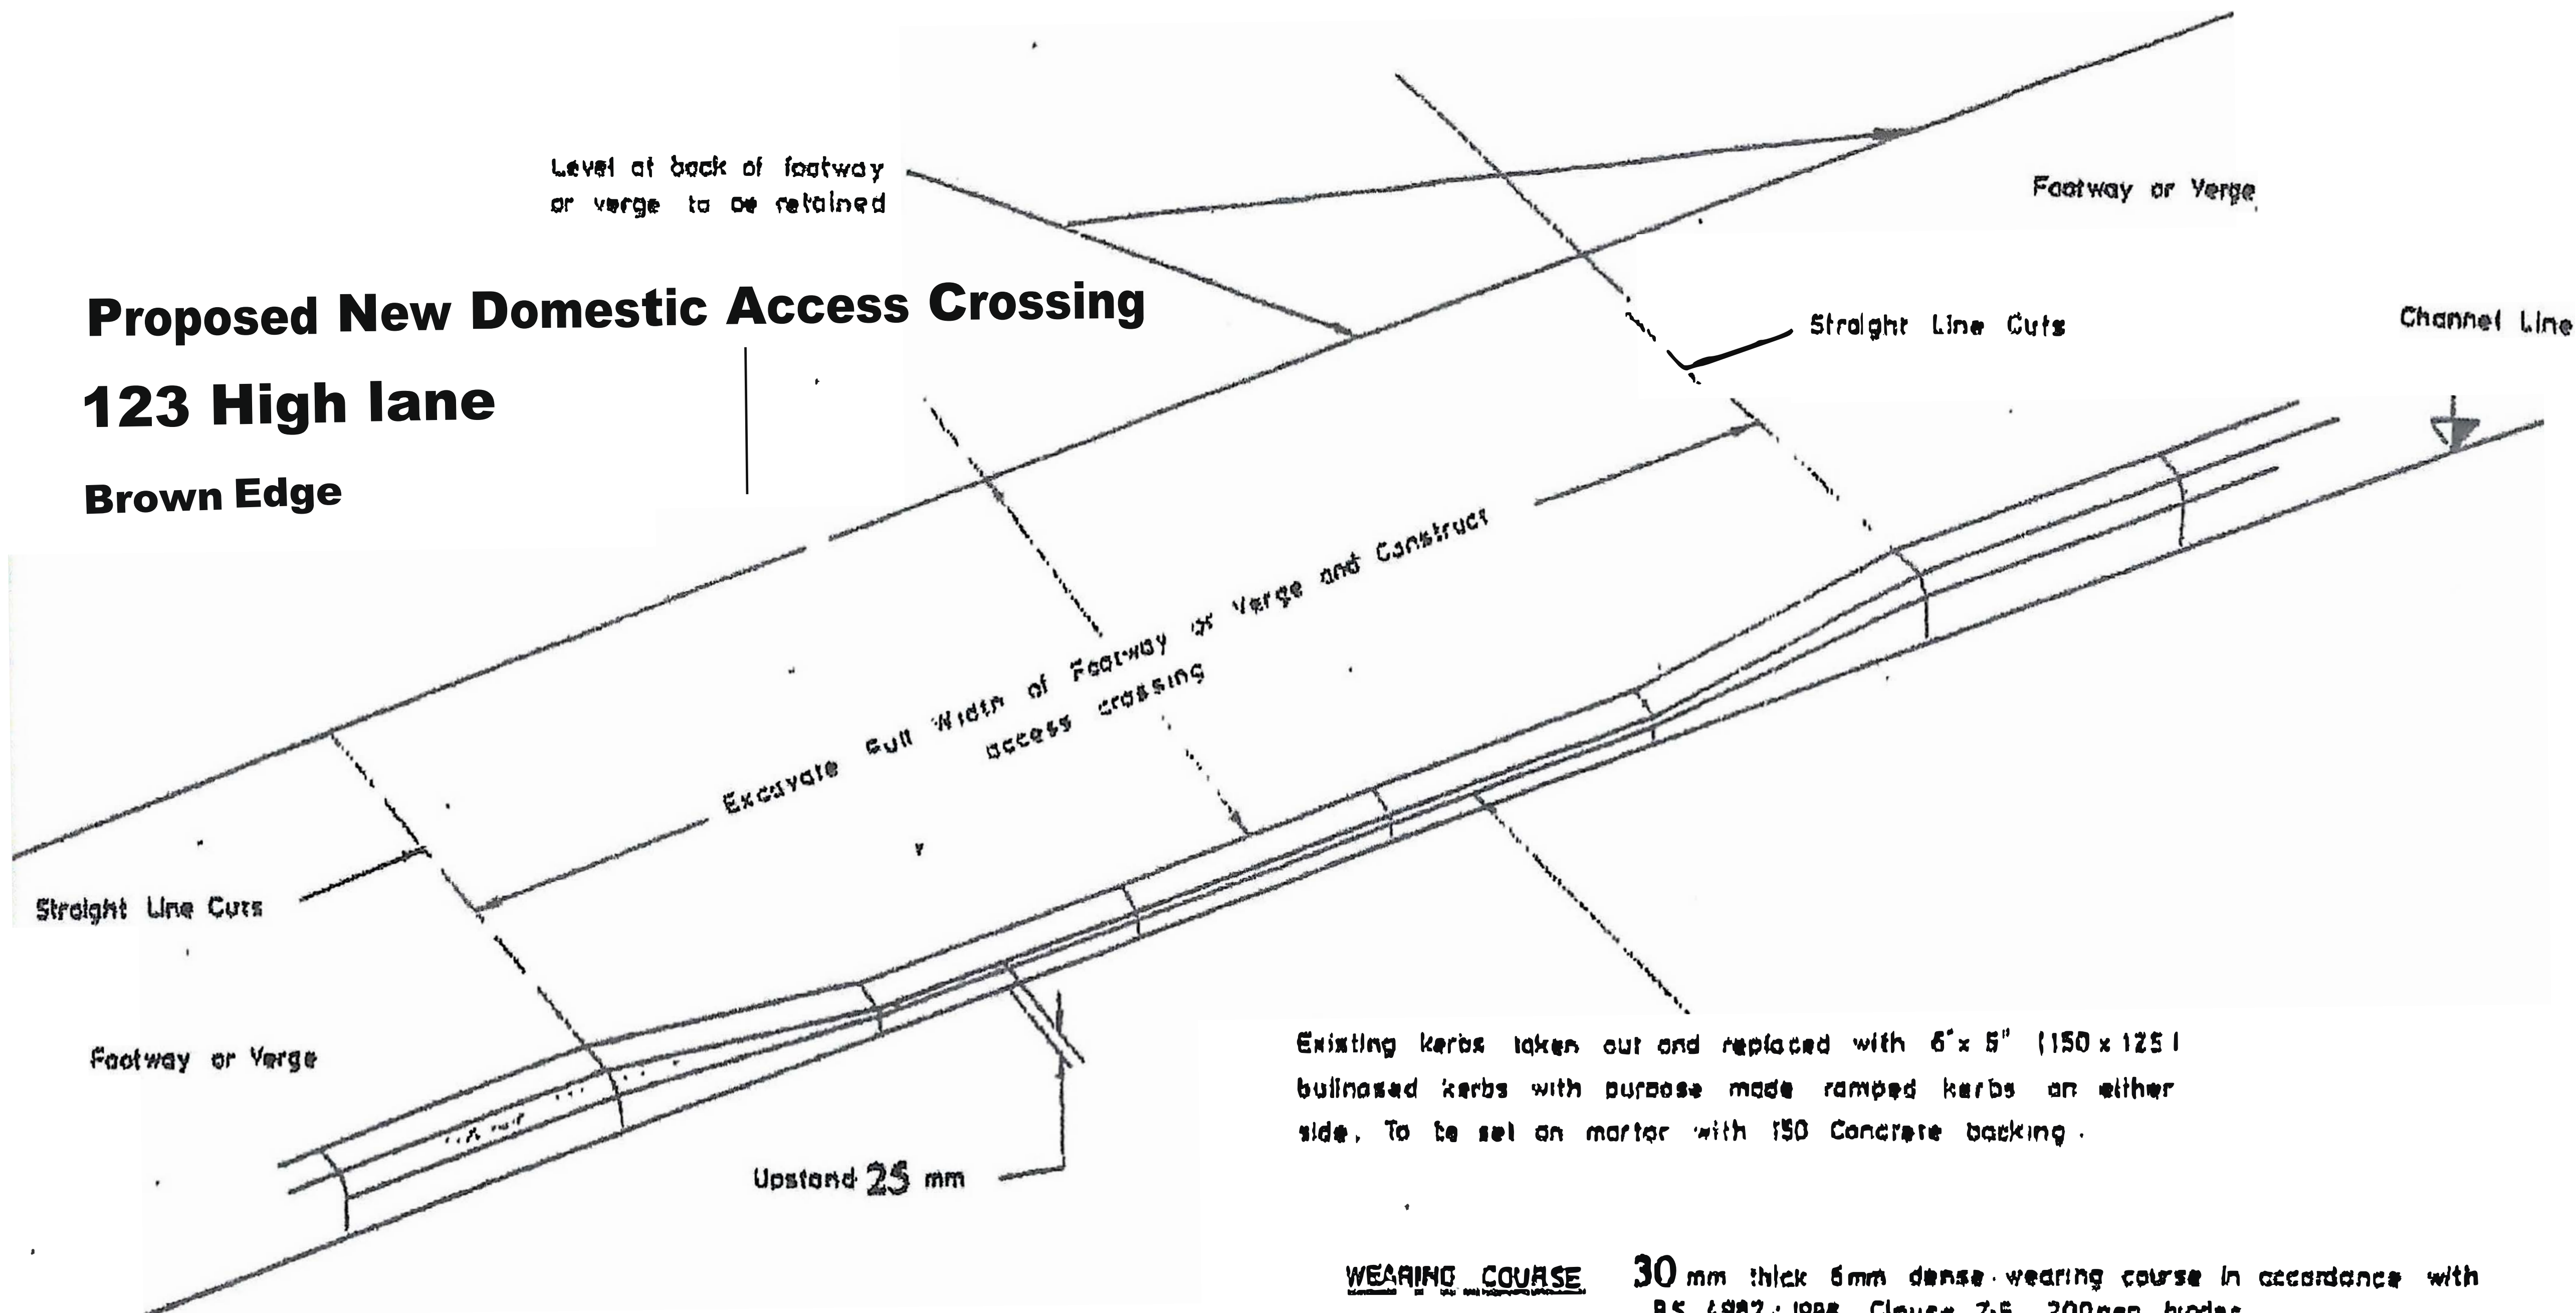

Existing kerbs taken out and replaced with 6" x 5" (150 x 125) bullnosed kerbs with purpose made ramped kerbs on either side. To be set on mortar with 150 Concrete backing.

NOTE

Where the footway is flag paved the slopes of each side of the access crossing must be saw cut to obtain the necessary falls and gradients, and all sloping flags must be bedded on 75mm of concrete grade S11. Flags only to be used under the instructions of the Engineer in Charge.

<u>WEARING COURSE</u>	30 mm thick 6mm dense wearing course in accordance with B.S. 4987:1988 Clause 7.5 200pen binder.
<u>BASE COURSE</u>	40mm thick 20 mm dense base course in accordance with B.S. 4987:1988 Clause 6.5 200open binder.
<u>ROAD BASE</u>	150mm thick O.S.B Type 1
<u>SUB BASE</u>	As required.
<u>CRUSHED ROCK</u>	AGGREGATE (NOT LIMESTONE OR SLAG) TO BE USED.

Extract from staffs County Council
Specification for
Domestic Access Crossing