


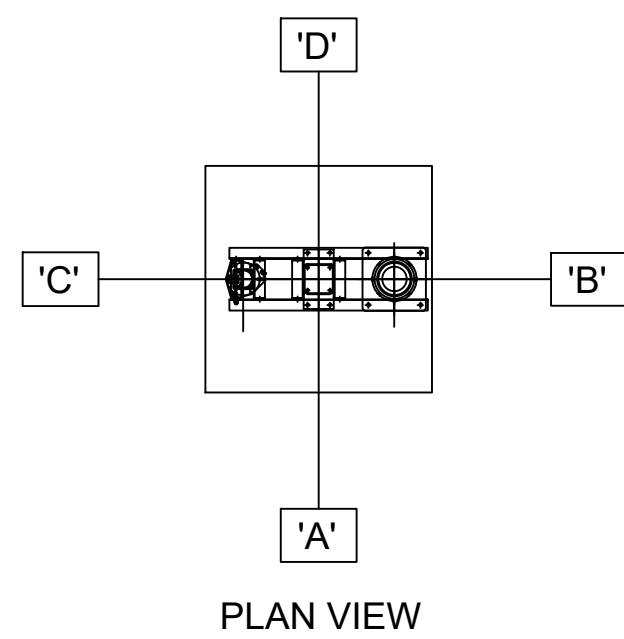
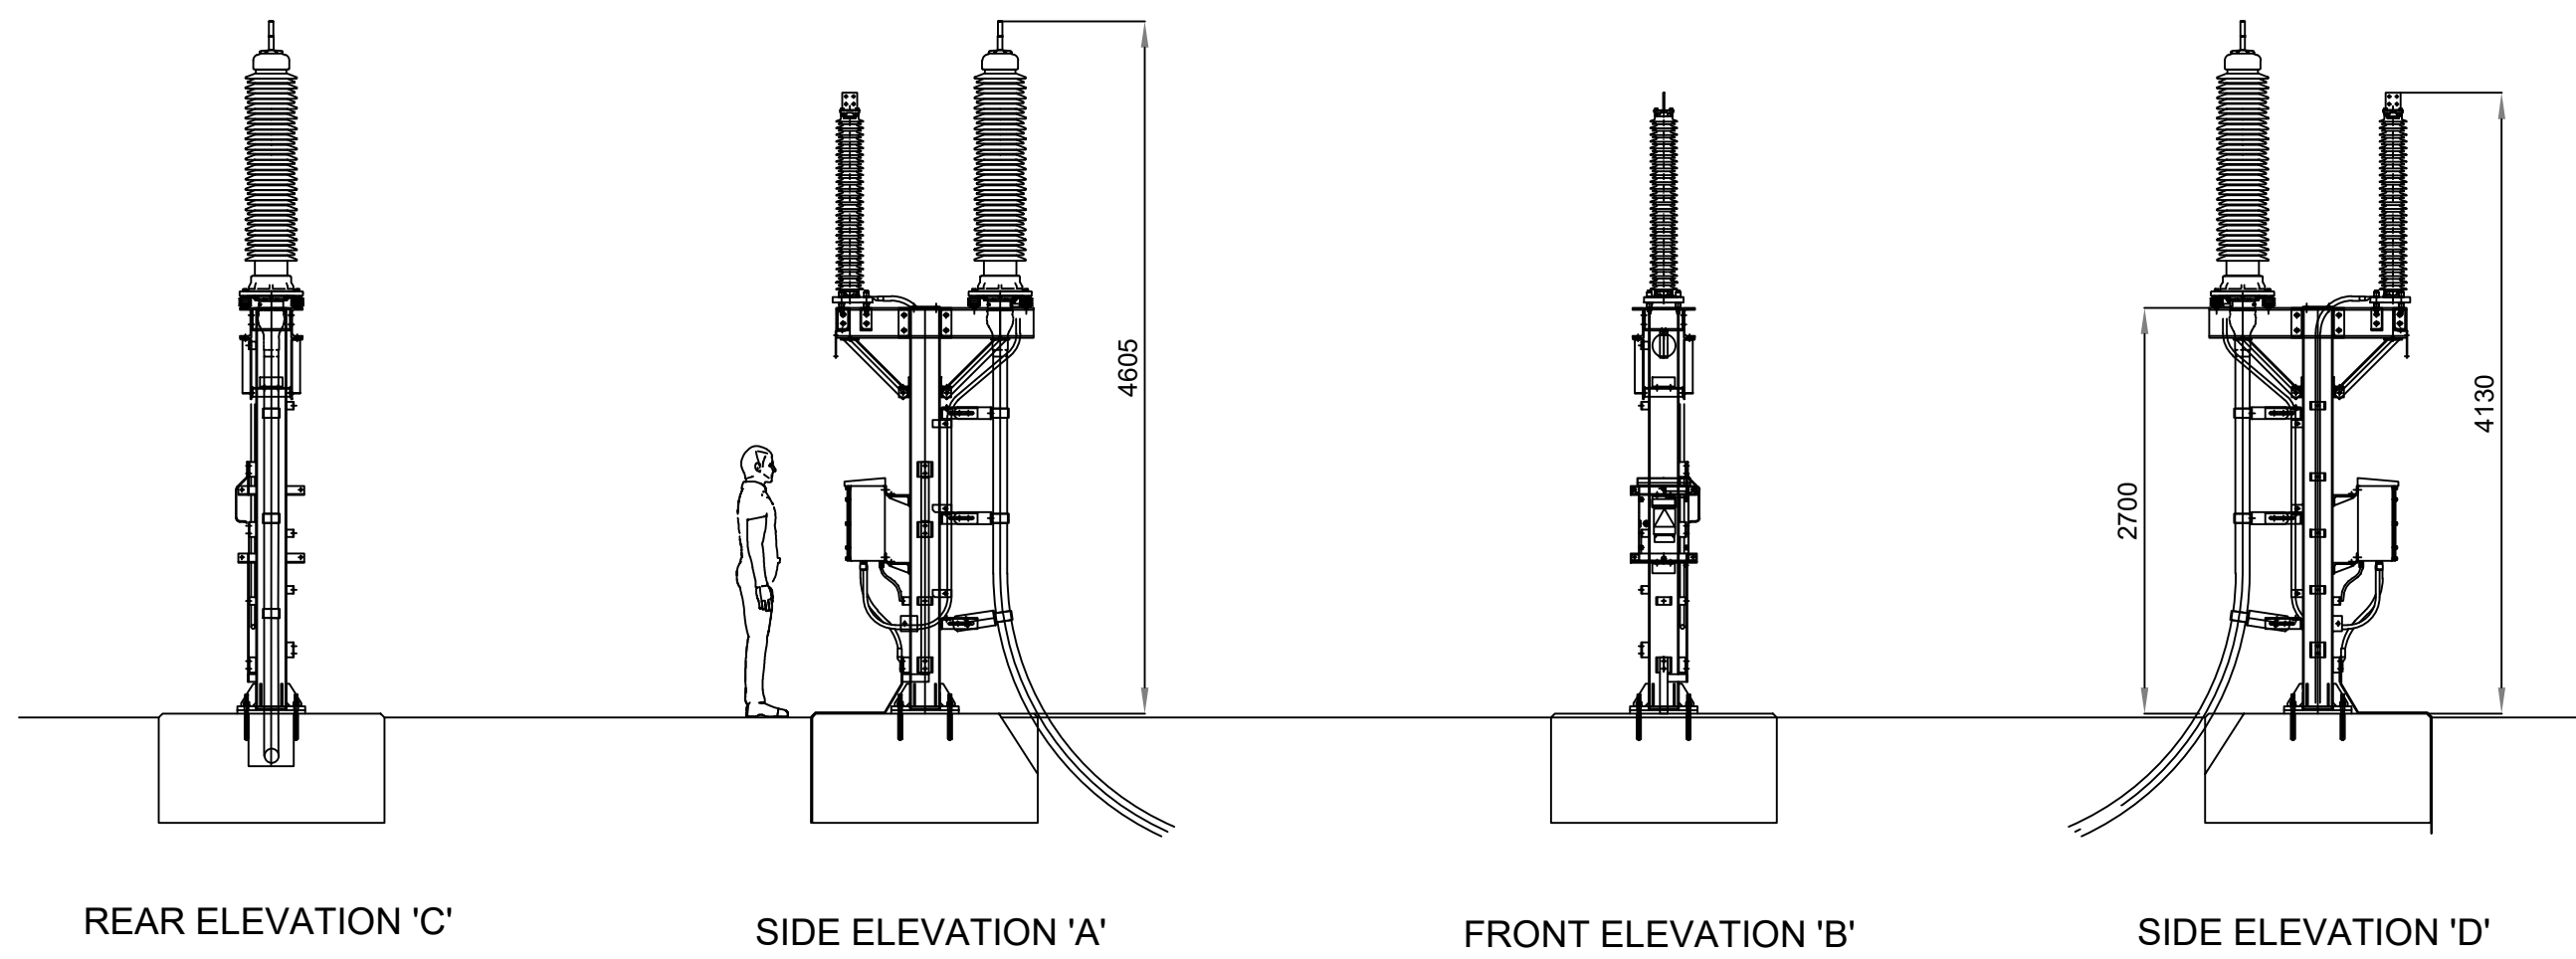
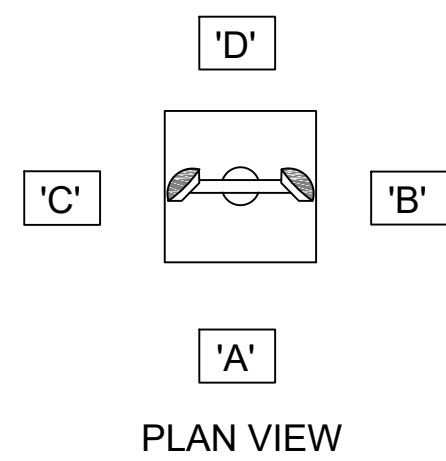


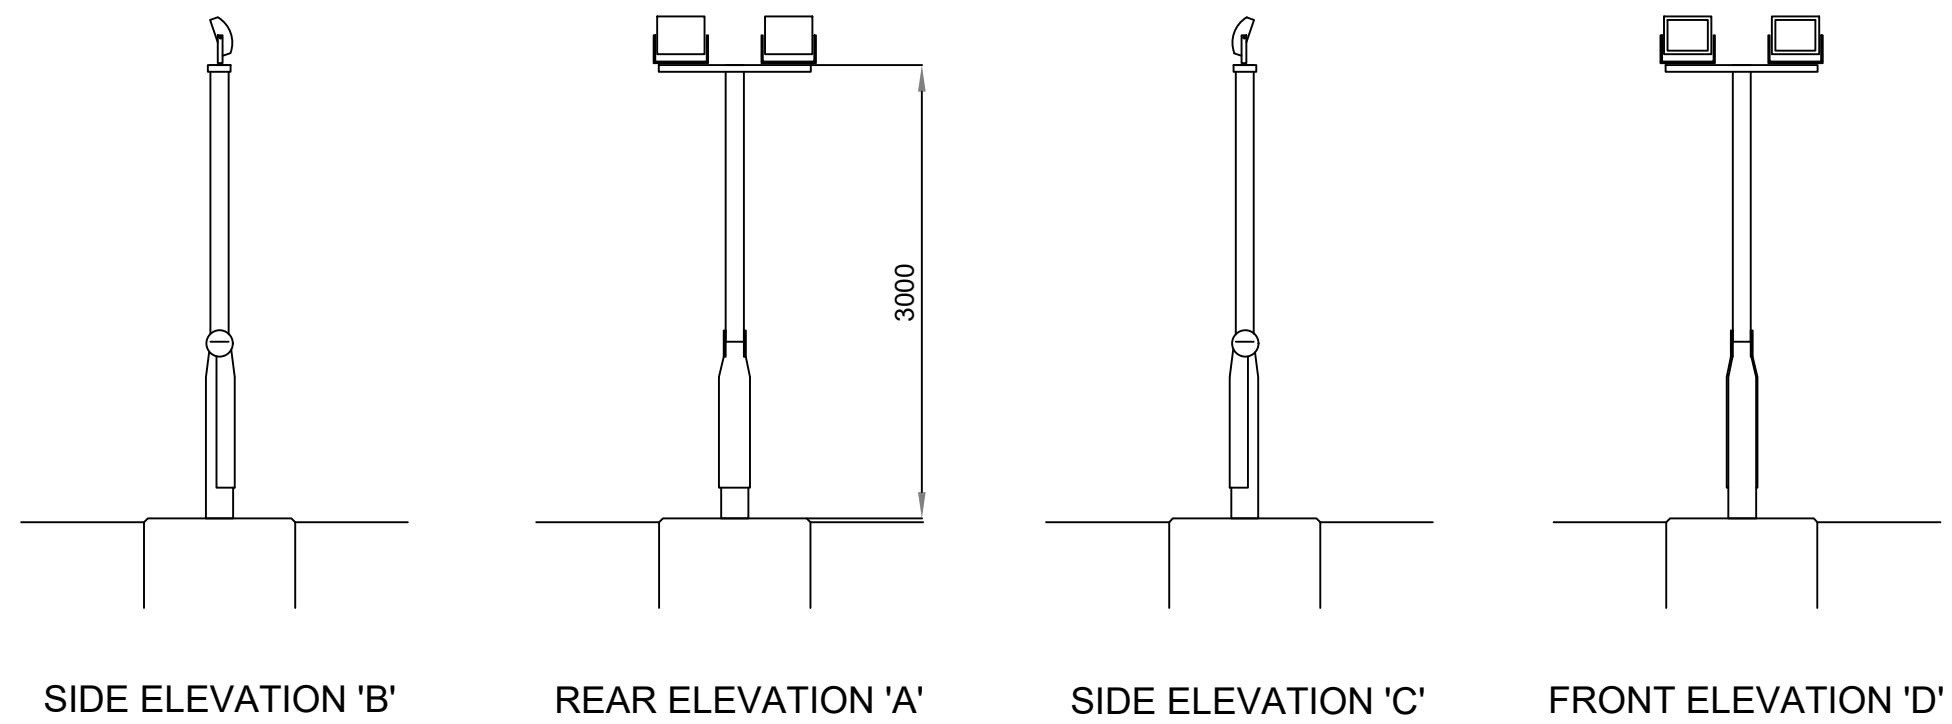

132kV COMBINED CABLE SEALING END
AND SURGE ARRESTER

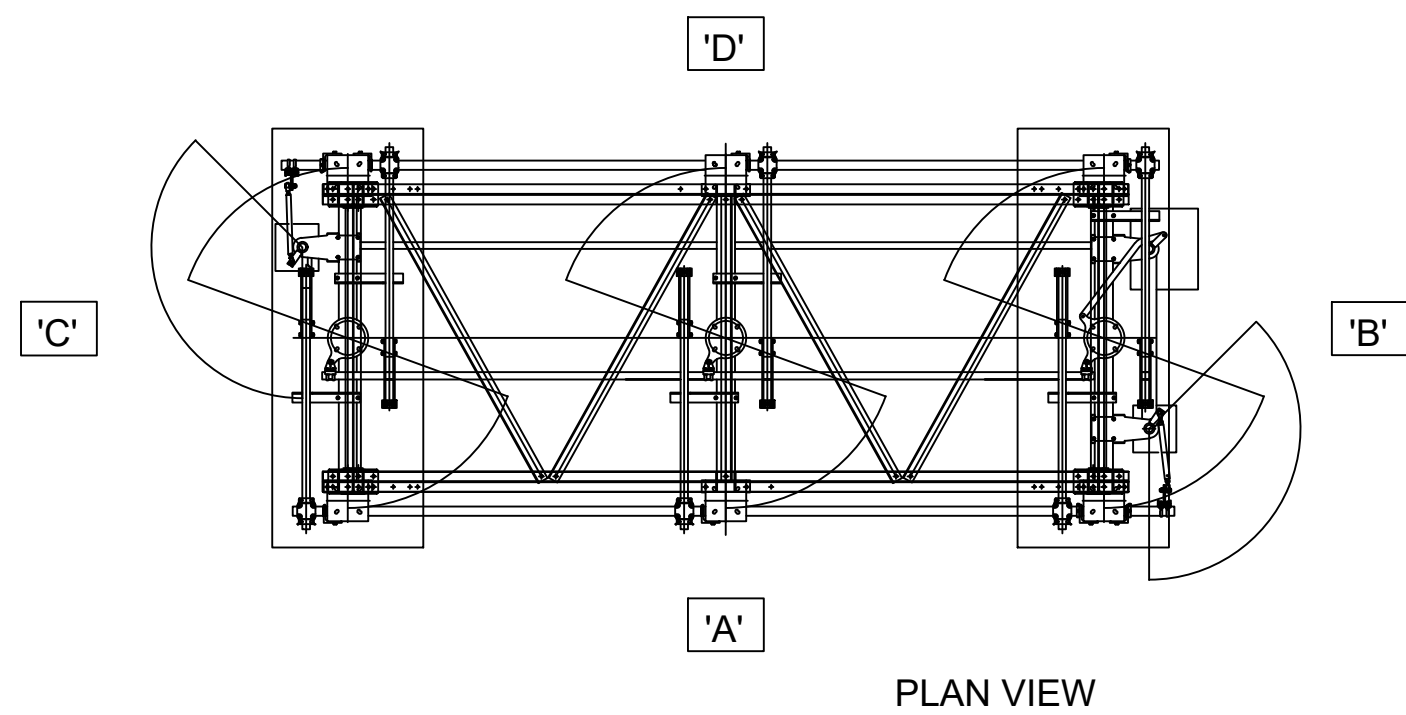

LIGHTING COLUMN

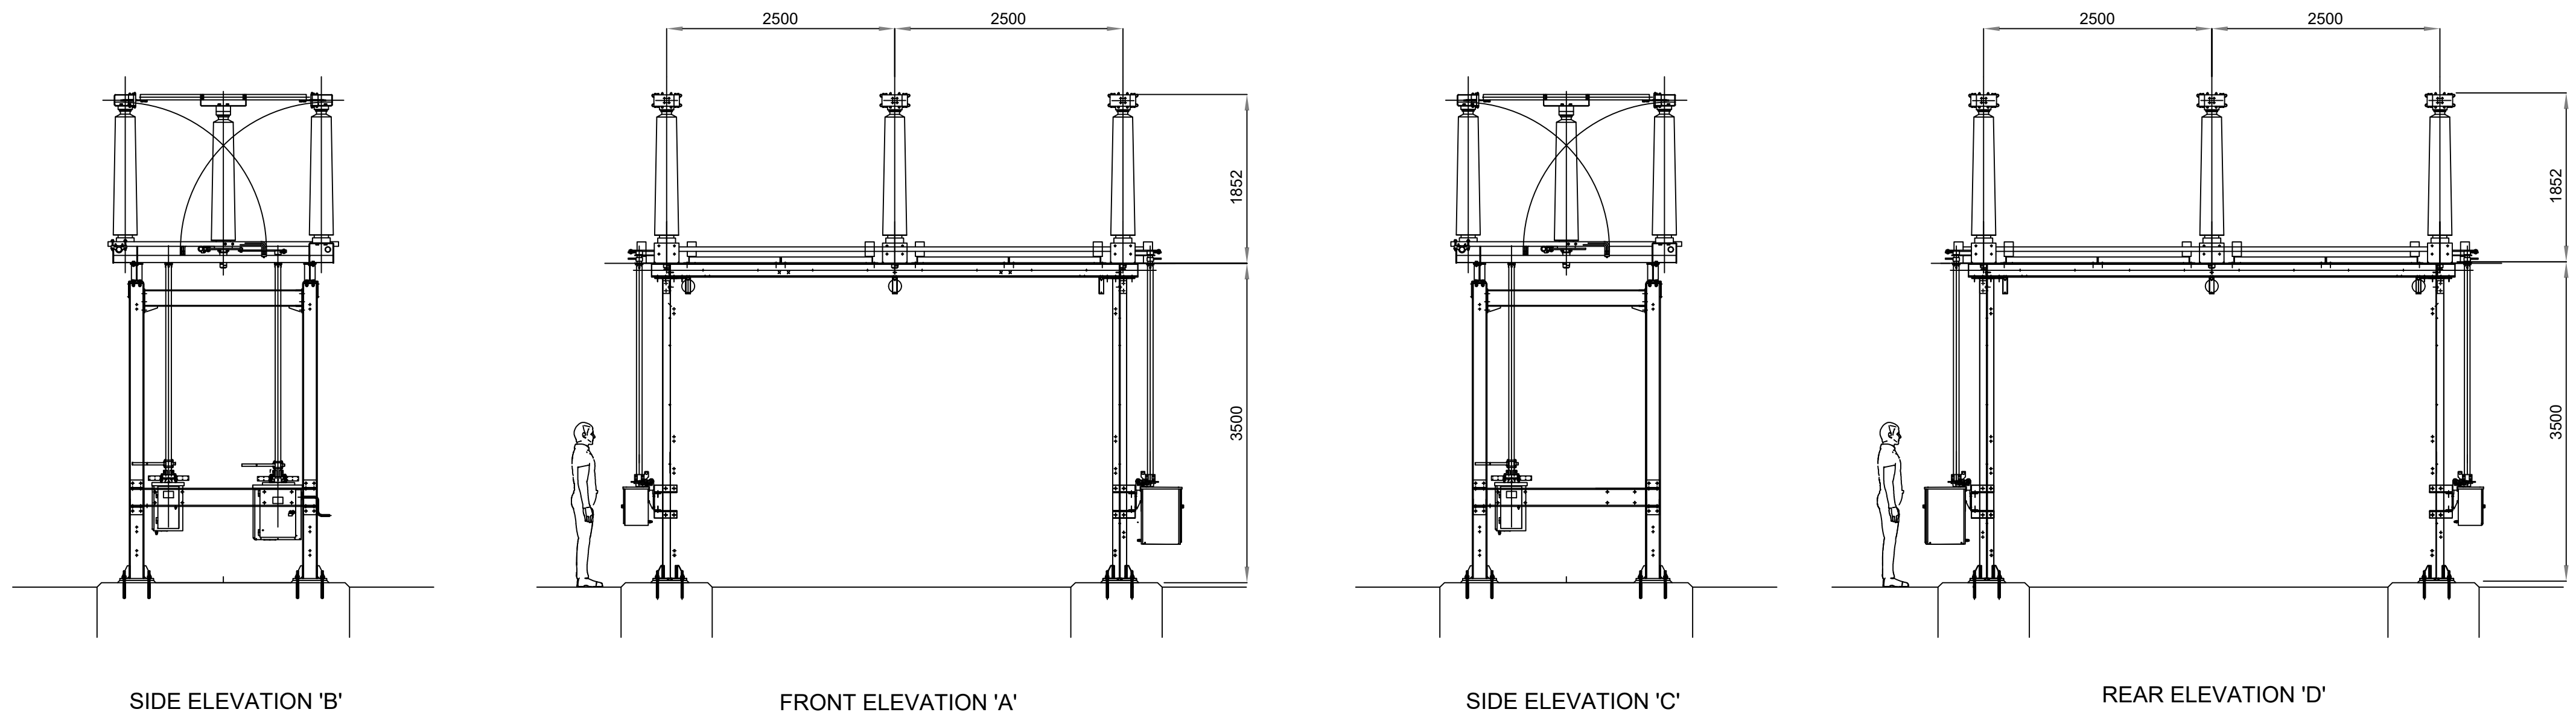

132kV DISCONNECTOR WITH
2 EARTH SWITCHES
(MEDIUM LEVEL)

1. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEERS AND SPECIALISTS DRAWINGS & SPECIFICATIONS.
2. ANY DISCREPANCIES BETWEEN THIS DRAWING AND ANY OTHER TO BE REPORTED TO THE ENGINEER IMMEDIATELY.
3. ALL WORKS TO COMPLY WITH THE MOST CURRENT BRITISH STANDARDS.
4. ALL DIMENSIONS IN MILLIMETERS UNLESS STATED OTHERWISE. NO DIMENSIONS ARE TO BE SCALED OFF THE DRAWING. USE FIGURED DIMENSIONS ONLY.
5. ALL DIMENSIONS TO BE $\pm 3\text{mm}$ UNLESS SPECIFIED OTHERWISE.
6. A RECESSIVE COLOUR SUCH AS GREY IS PROPOSED, BUT CAN BE AGREED WITH OFFICERS.

Project: Newfields Farm BESS

Drawing name: Plan and Elevations of 132kV Switchyard - DNO Compound

88-10-05-C-PL-EQ-02	REN	
R.00	First Issue	21.03.2022
Revision	Description	Date
Discipline: Electrical	Phase: Preliminary Design	Format: A1 Scale: 1:50 Sheet No: 02 / 03

Client: REPD

RENERGY LTD
28 E Samokov str.
1113 Sofia, Bulgaria
info@renergy-bg.com
www.renergy-bg.com

This drawing may not be reproduced or be made available to third person or competing companies without RENERGY permission. This reproduction, distribution and utilization of this document as well as the communication of its contents without explicit authorization is prohibited. Offenders will be held liable and can find up to 50% of the project cost variations in design can occur to site conditions.