


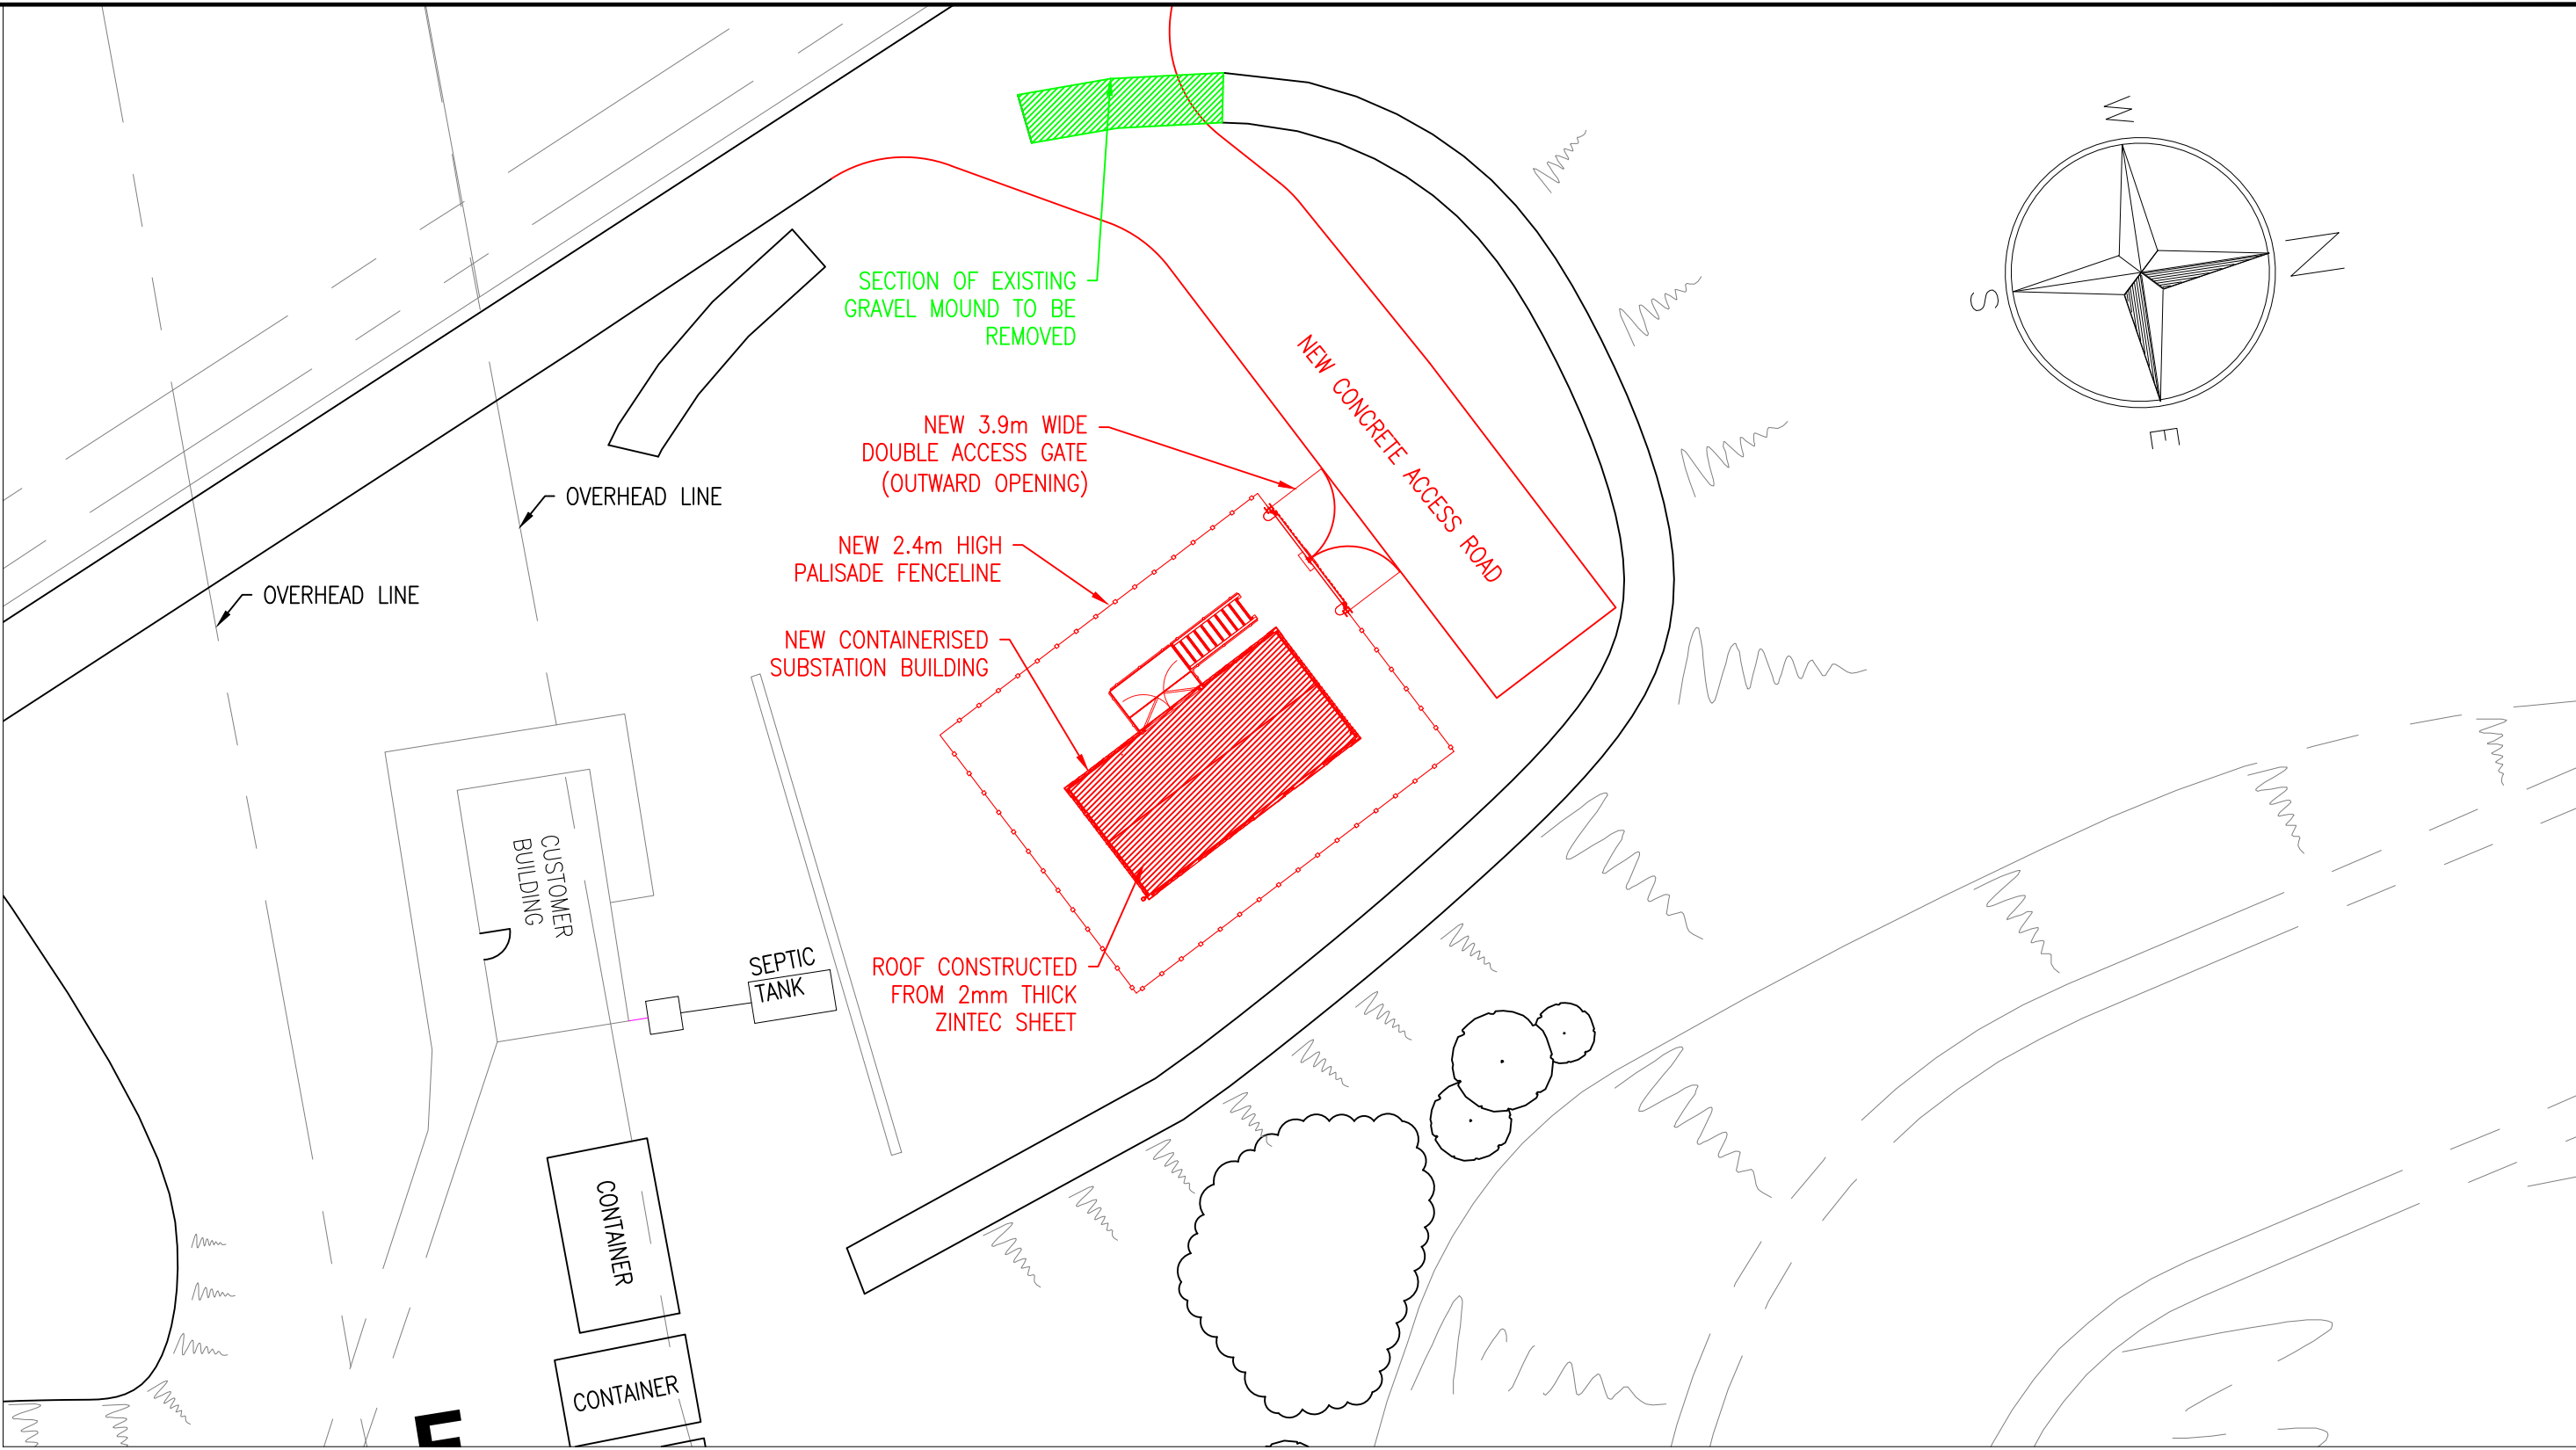


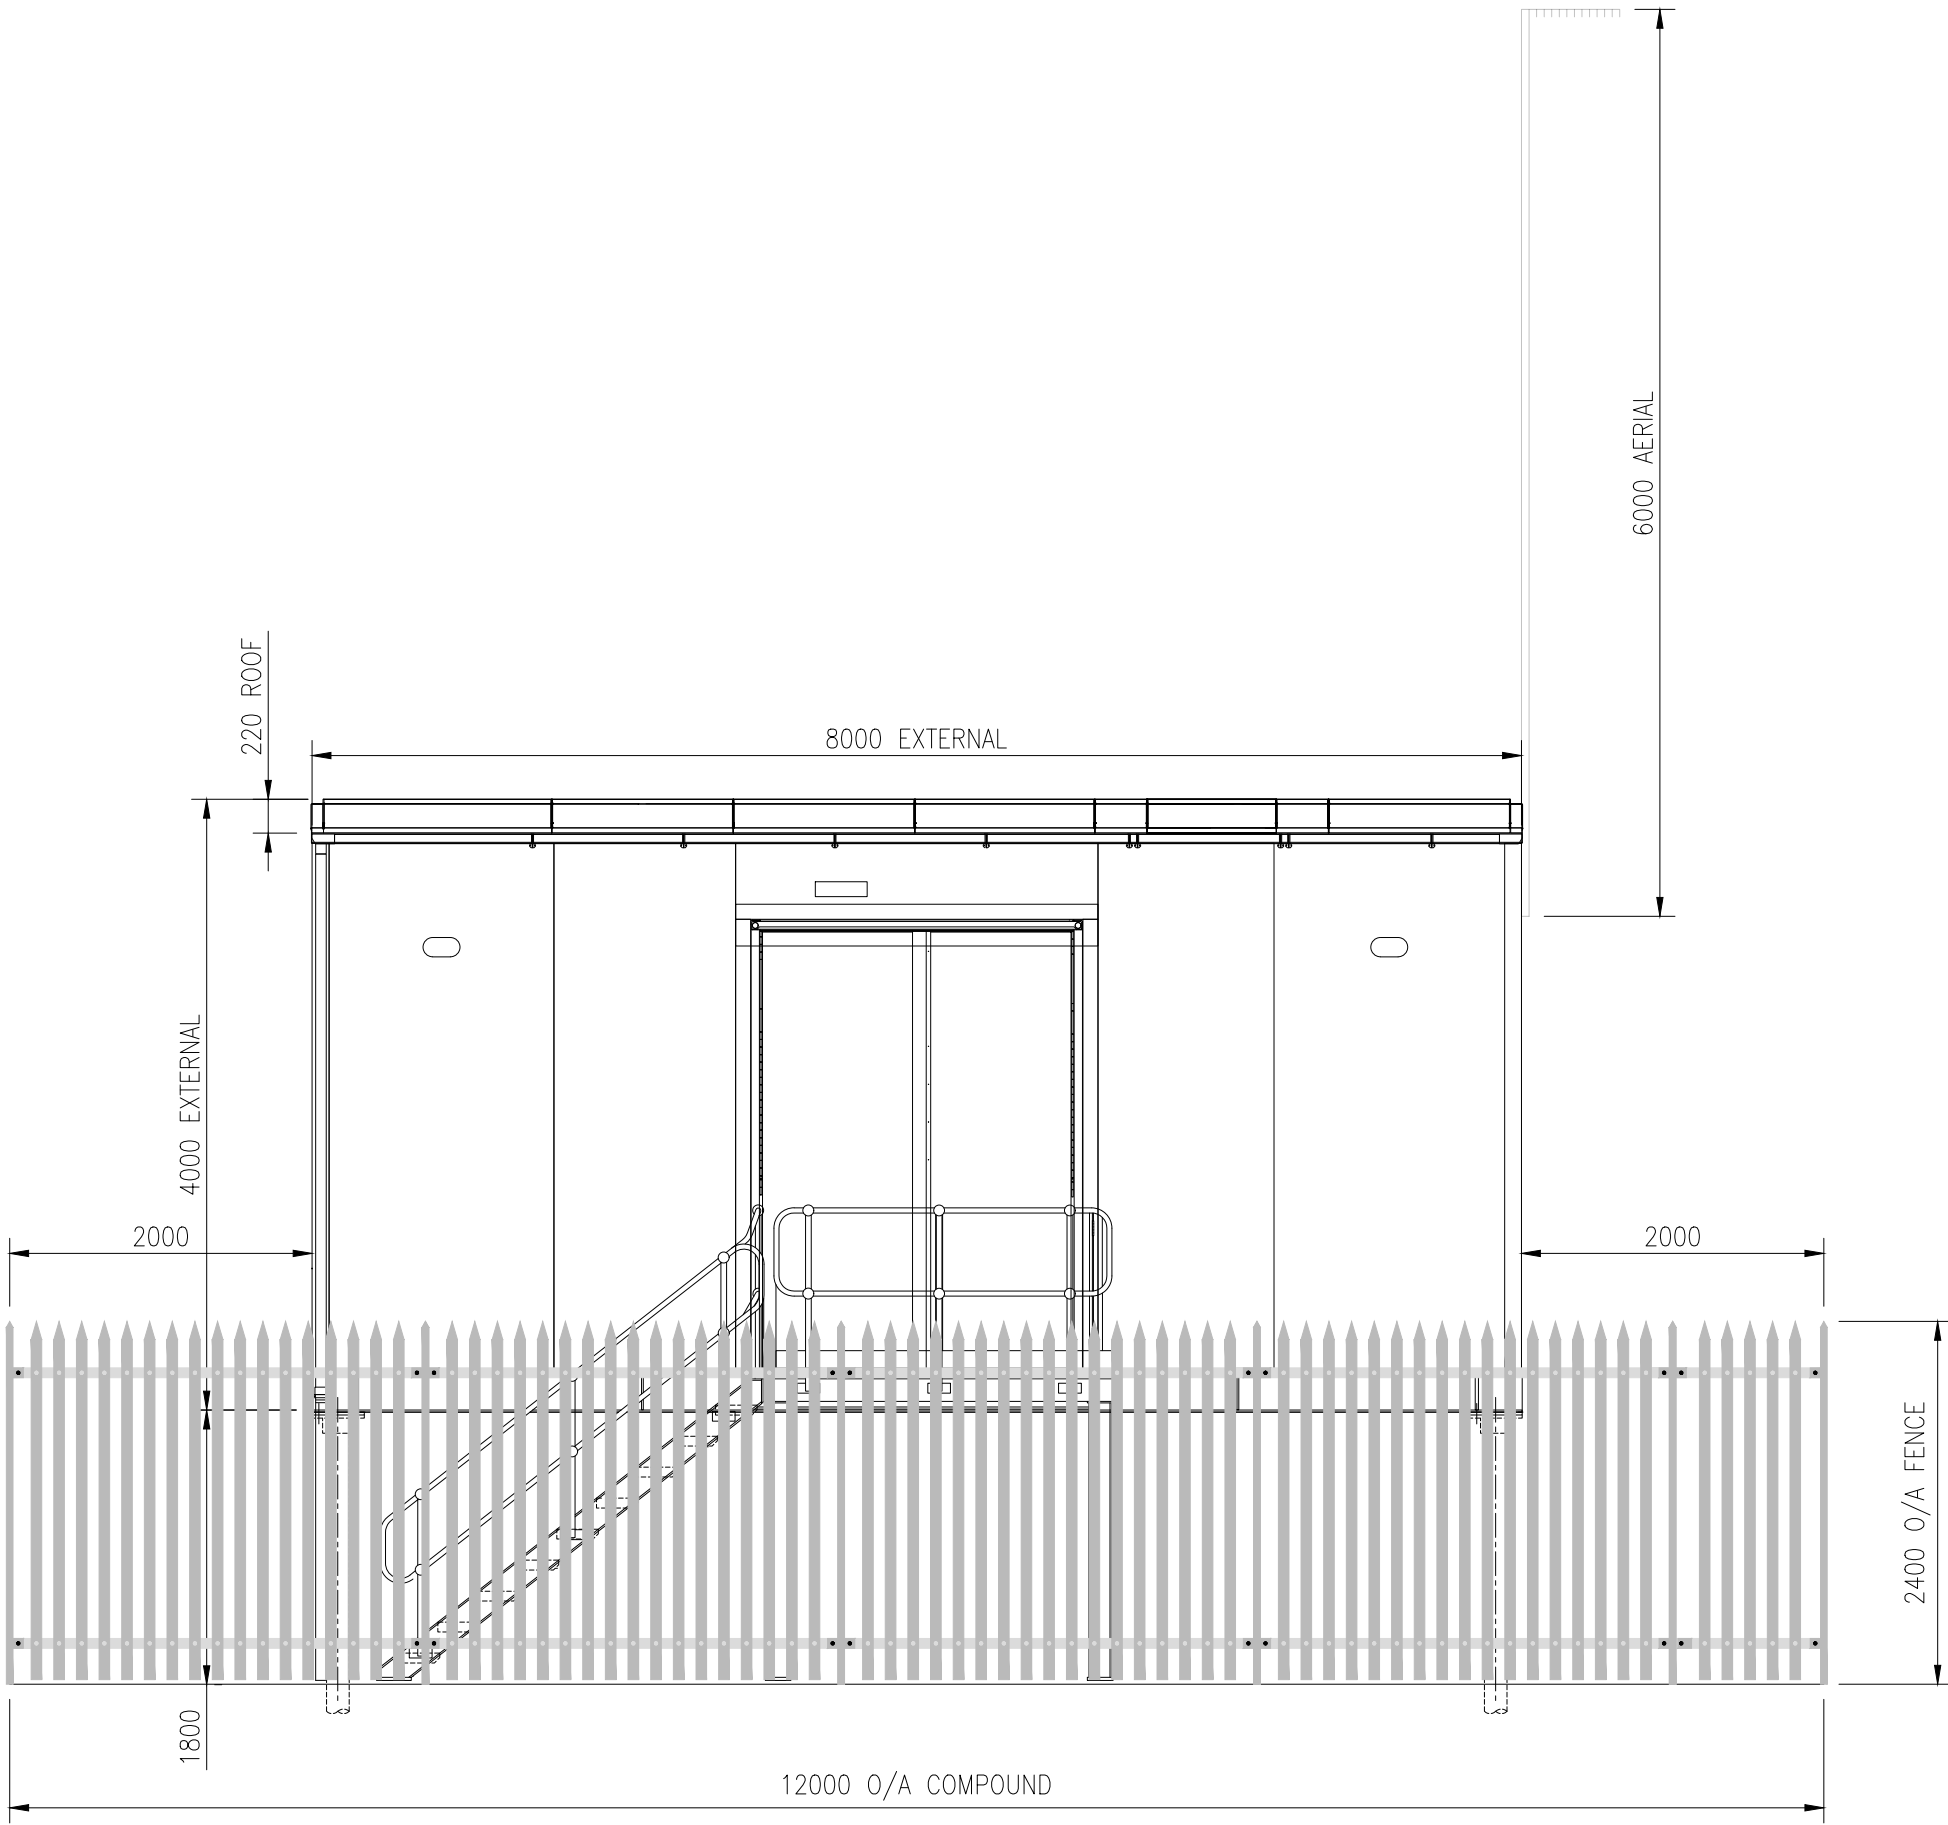


SITE PLAN
SCALE 1:200

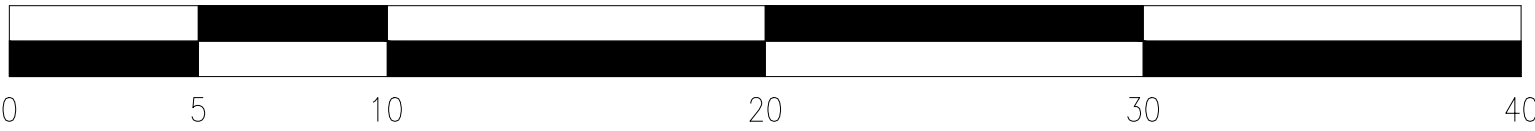

SOUTH WEST ELEVATION
SCALE 1:50

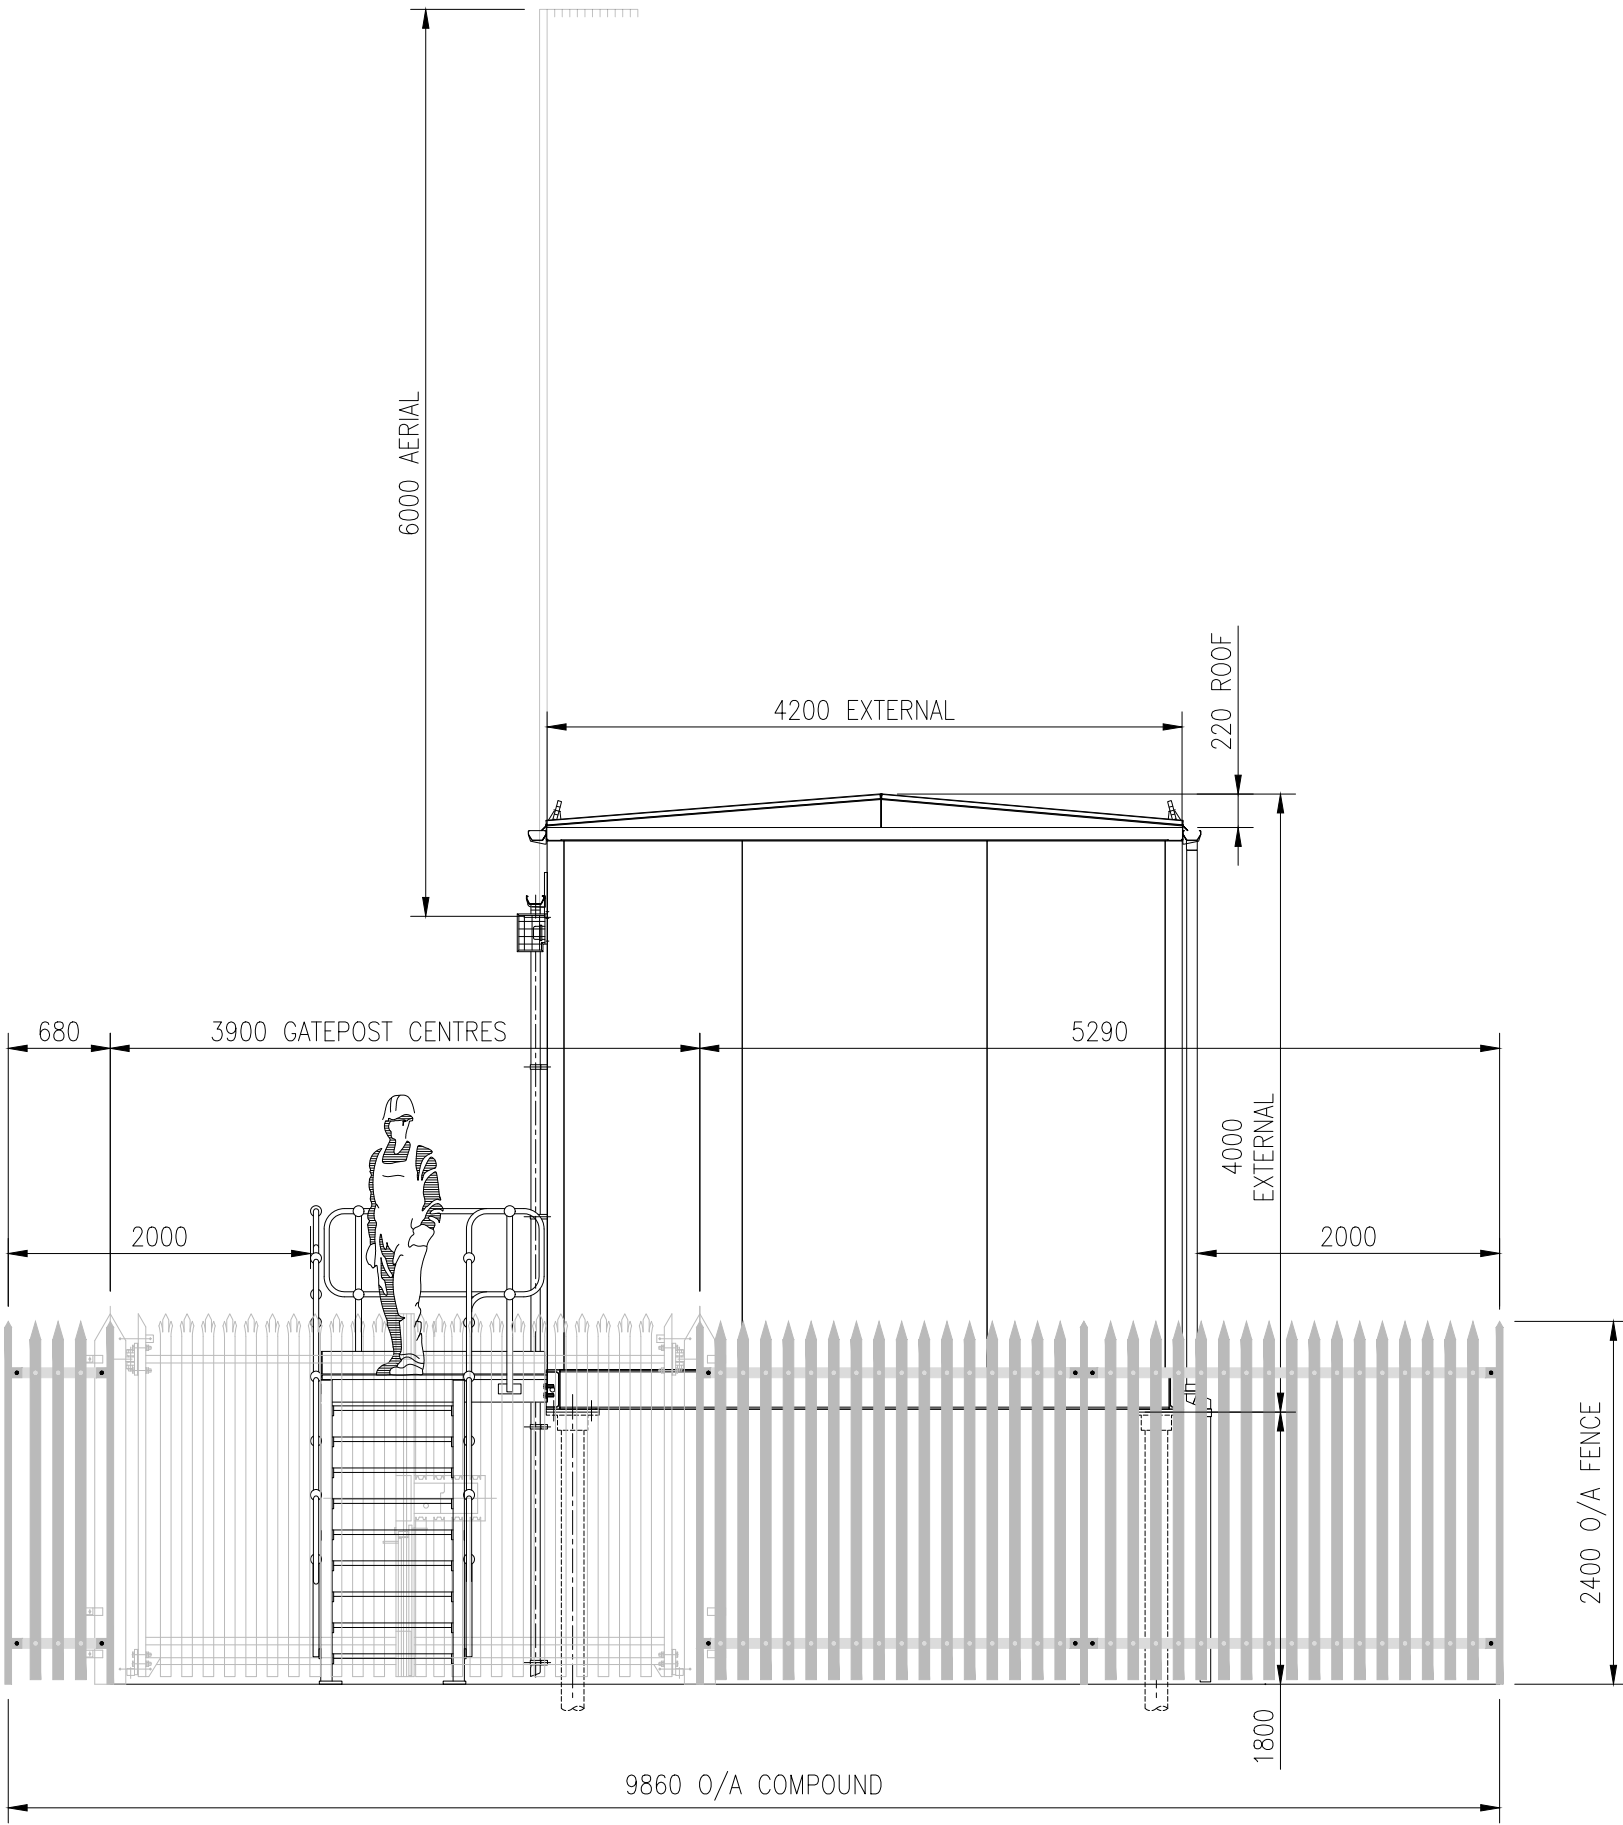

NORTH WEST ELEVATION
SCALE 1:50

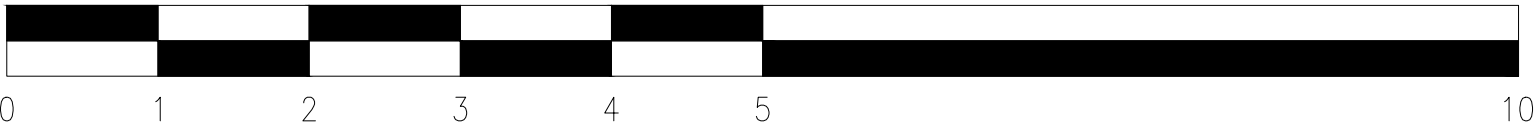

- DRAWING NOTES:
1. INDICATED PLOT SIZE DETAILS MINIMUM REQUIRED FOOTPRINT TO ACHIEVE 2m CLEARANCE FROM ANY METALLIC OBJECT TO THE EXTERNAL COMPOUND FENCE LINE.
 2. COMPOUND FENCE LINE AND ACCESS GATES TO CONFORM WITH NGED ENGINEERING EQUIPMENT SPECIFICATION EE:20/4 – RELATING TO SUBSTATION SECURITY FENCING.

REV. 1	07/07/2025	REV. 2		REV. 3		REV. 4		REV. 5	
CHECKED	NGED_ED	CHECKED		CHECKED		CHECKED		CHECKED	
APPROVED	NGED_ED	APPROVED		APPROVED		APPROVED		APPROVED	
UPDATED IN LINE WITH DALCOUR MACLAREN COMMENTS.									

NOTES:

FOR PLANNING

DRAWN	RMA	07.07.2025
CHECKED	RE	07.07.2025
APPROVED	NGED_ED	07.07.2025
SCALE	1:50, 1:200	© A1
ALL RIGHTS ARE RESERVED TO NATIONAL GRID ELECTRICITY DISTRIBUTION (NED) AND ITS COMPANY NUMBER (00000000) NO PART OF THIS DRAWING MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, INCLUDING PHOTOCOPYING AND RECORDING, OR STORED IN A RETRIEVAL SYSTEM OF ANY NATURE WITHOUT WRITTEN PERMISSION.		

CAULDON CEMENT 33/11kV SUBSTATION
PROPOSED SITE ELEVATIONS

nationalgrid **Electricity Distribution**

DRAWING No. NS17-102-007
REV 1
SHEET 1 of 1