




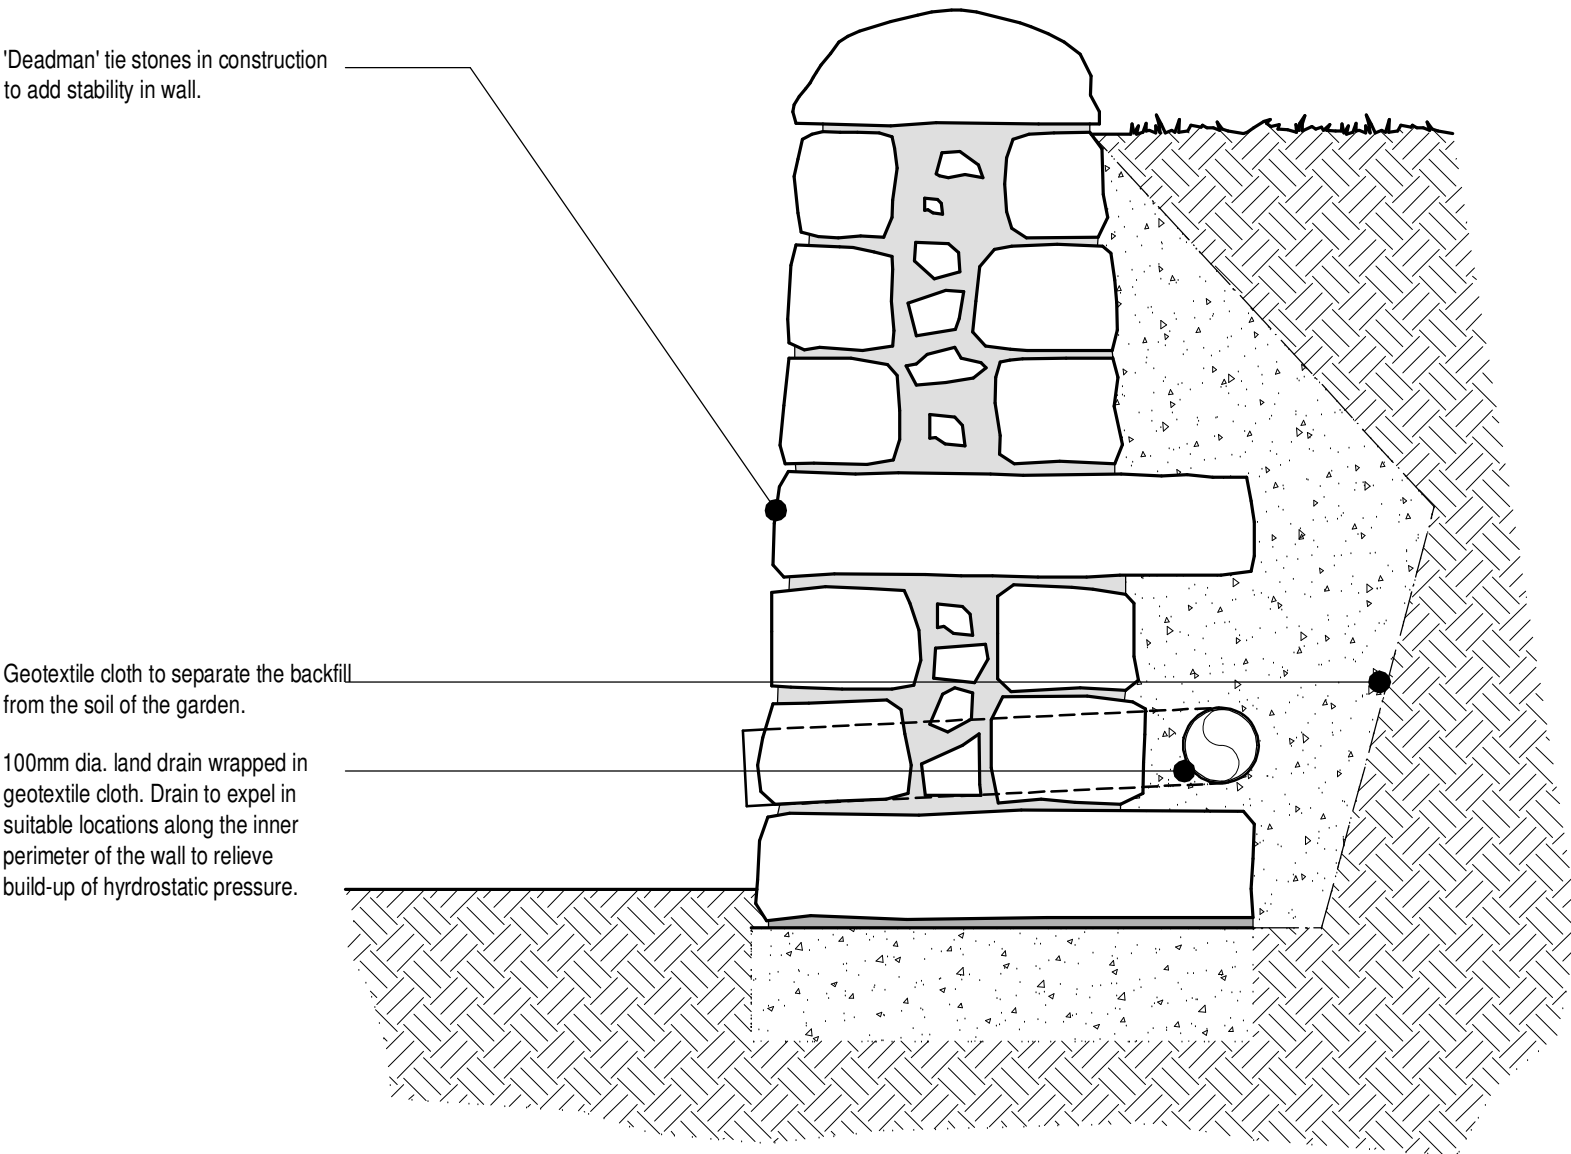

Cross Section - Retaining wall

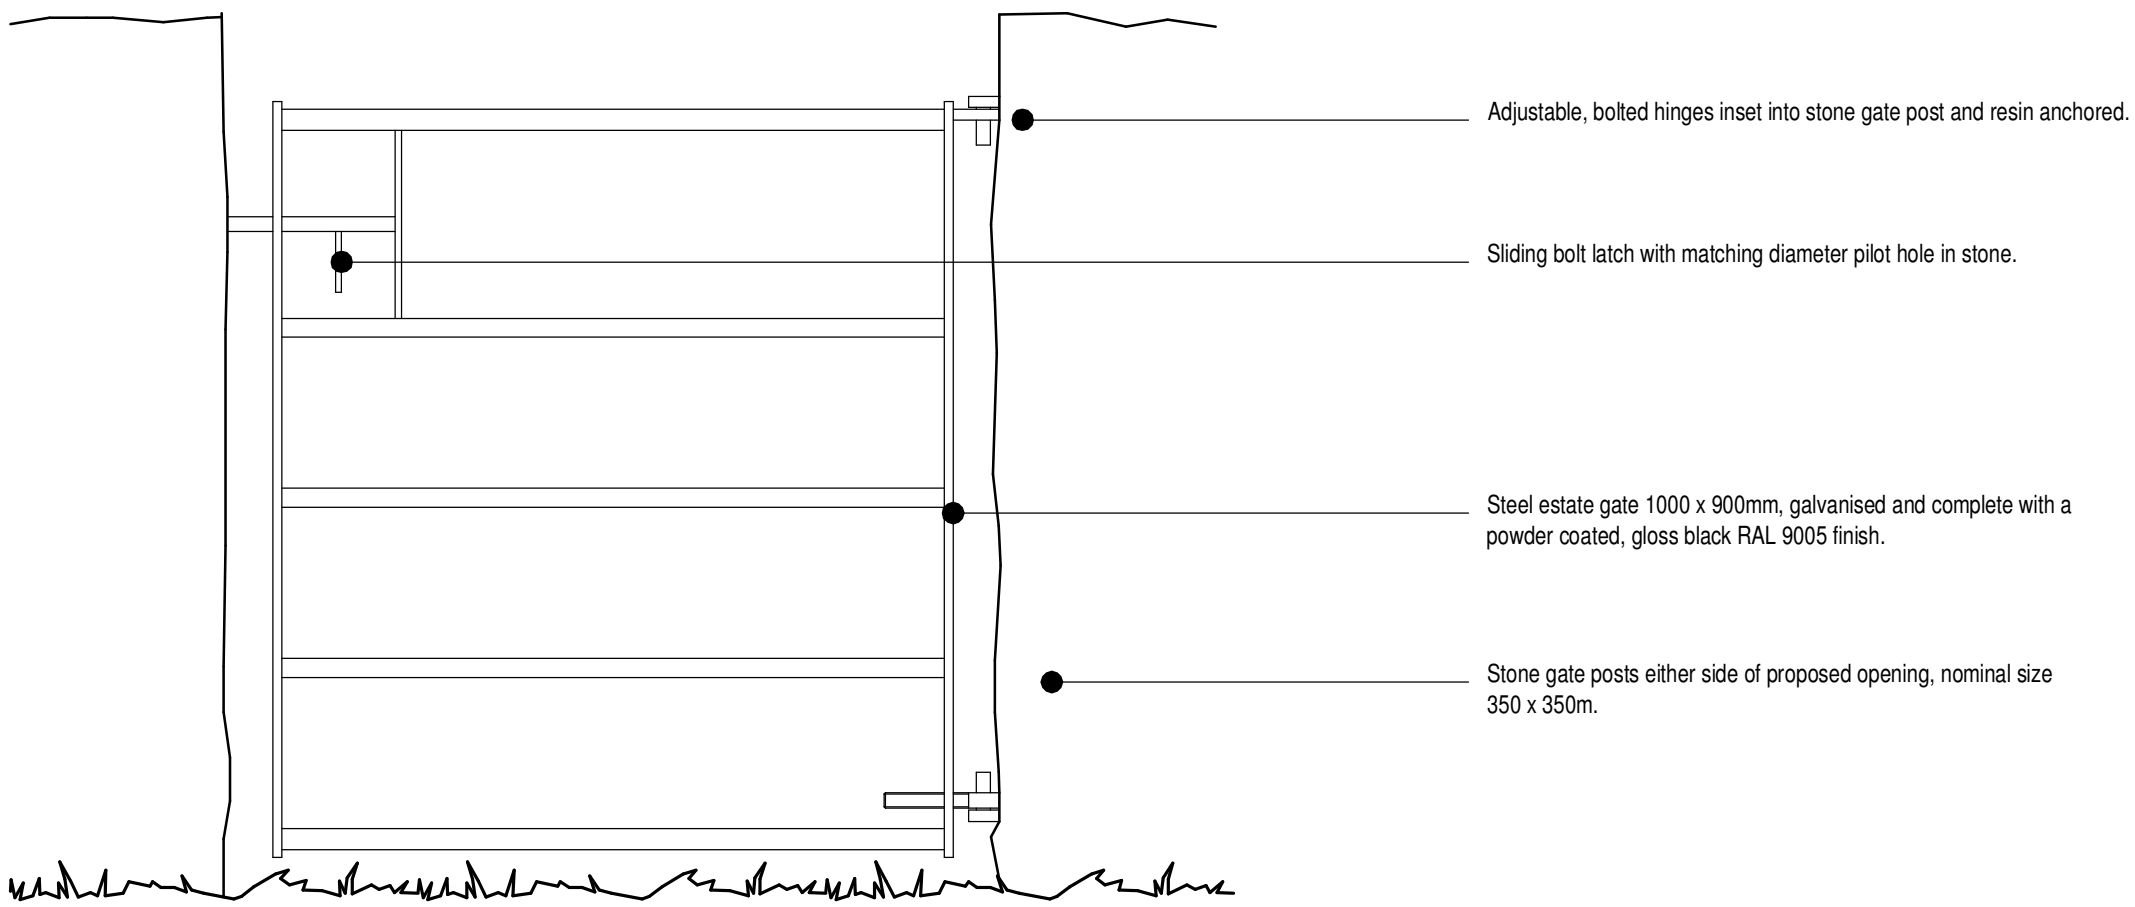


Elevation - Pedestrian Gate

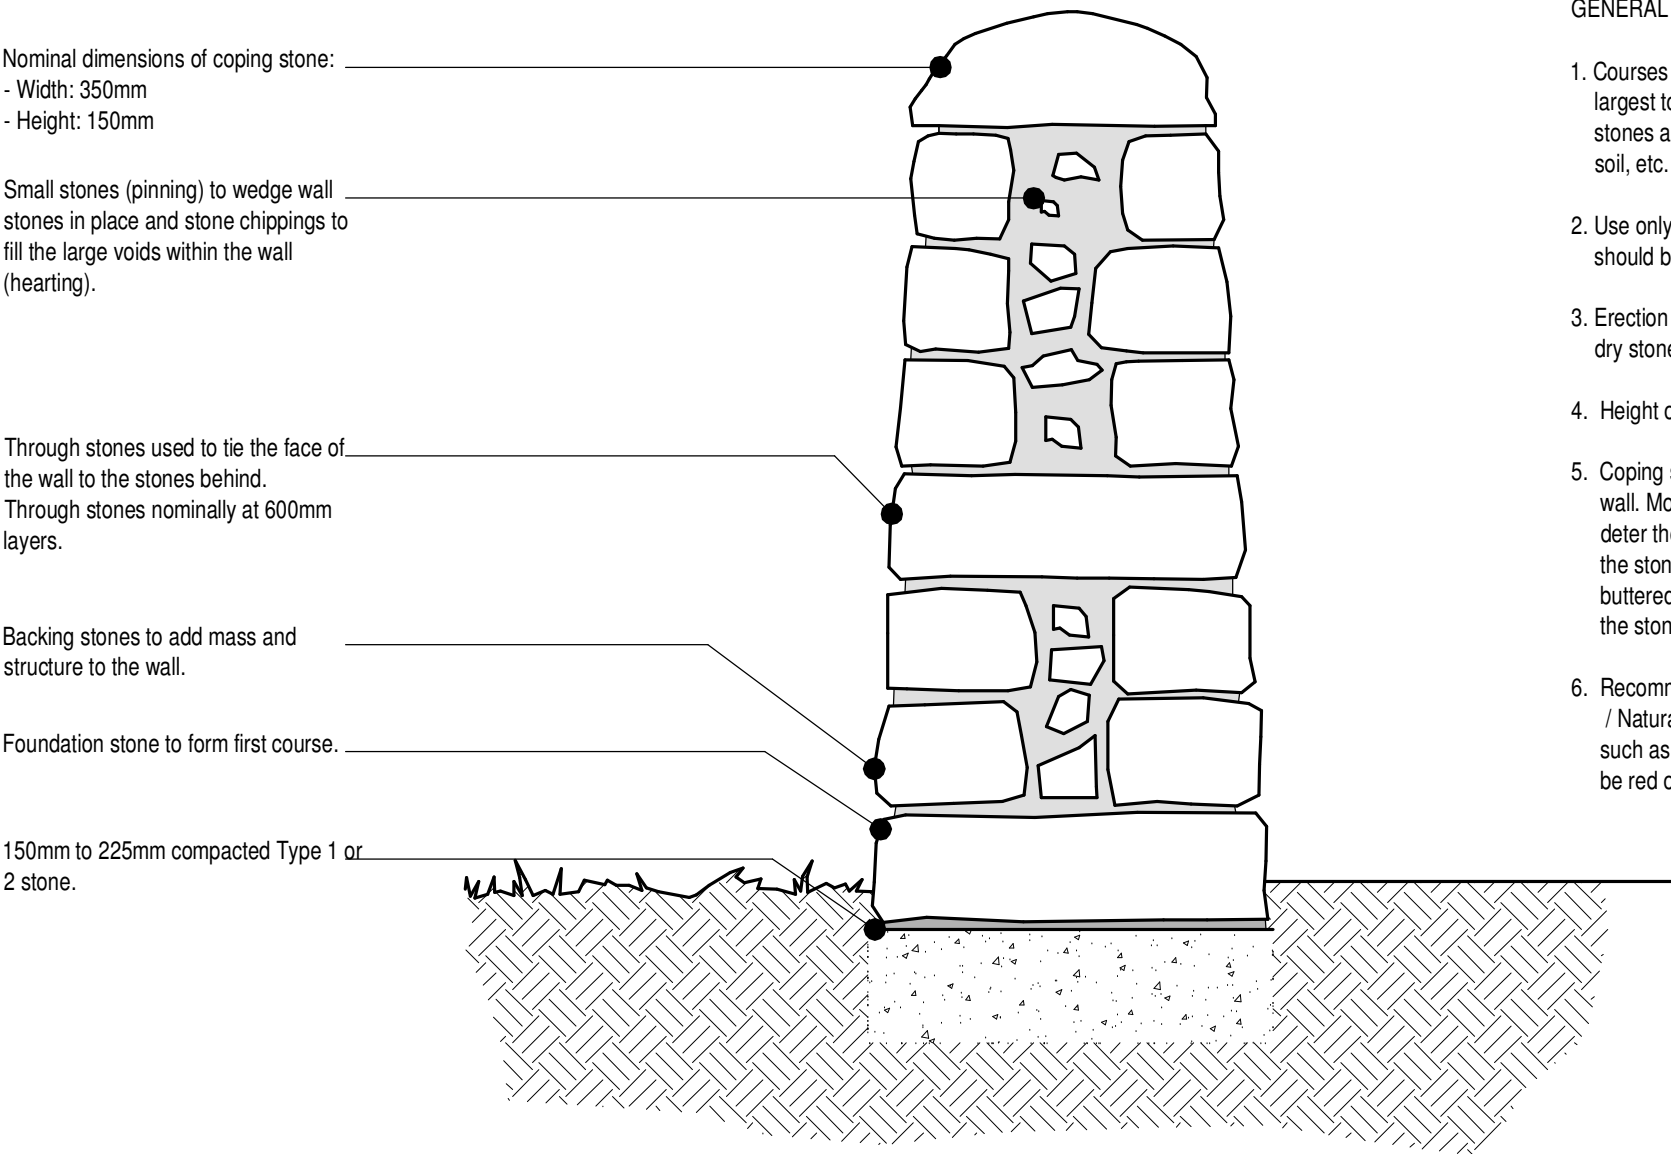


Cross Section - Non retaining wall

GENERAL NOTES

- Courses to be horizontal with stones, generally graded largest towards the bottom, with the exception of through stones and the like. Stones should be clean and free from soil, etc.
- Use only local stone where patching and existing stones should be faced with weathering and lichen outermost.
- Erection of all walls to be carried out by a proficient dry stone waller.
- Height of wall to be approx 1000mm height.
- Coping stones to be bedded with mortar on the retaining wall. Mortar below coping stones to be suitably pointed to deter theft (minimum 25mm from the external face of the stone). There should be no wide joint profiles or buttered/strap pointing - just sufficient mortar to keep the stones in place.
- Recommended mortar mix is 1:3 / Natural Hydraulic Lime (NHL) 5 / local aggregate such as Nosterfield or Mercaston (sand should not be red or have too high a clay content).

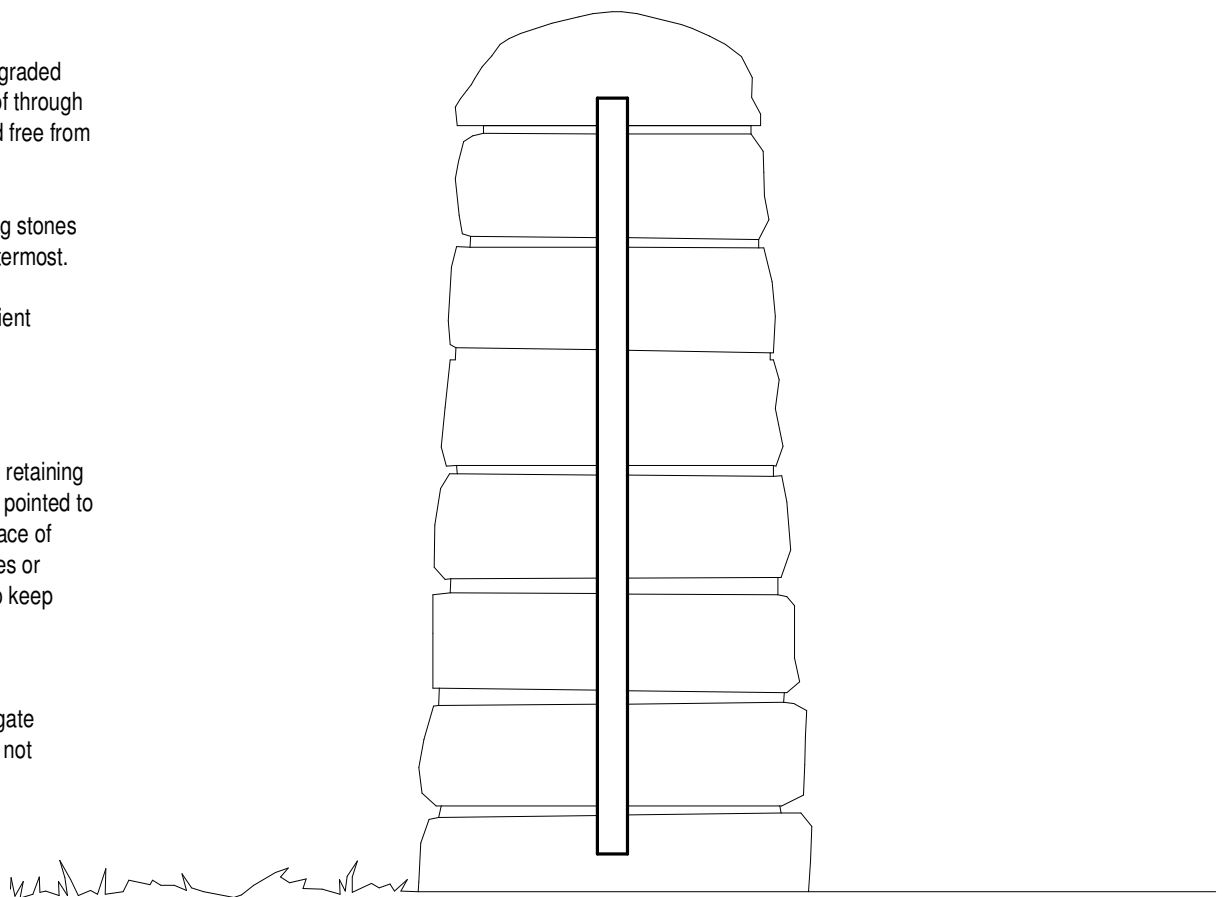

Cross Section - Pedestrian Gate

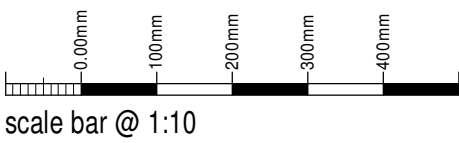

Mr & Mrs Wilbraham

Proposed Alterations to
Gate Farm,
Foxt,
Stoke-on-Trent,
ST10 2HN

Planning Proposal
Dry Stone Wall and Gate Details

Date	Sheet	Scale
October 2025	A2	1:10
Dwg No.	Rev.	Drawn
2024-2949-12	A	NAW

A - 10/11/2025 - HEIGHT OF WALL AMENDED



10 Cawdry Buildings, Fountain Street, Leek. ST13 6JP
Telephone: 01538 386002
E-mail: info@sammonsLtd.co.uk
Web: www.sammonsLtd.co.uk

This drawing is copyright.
All dimensions must be checked prior to commencement.