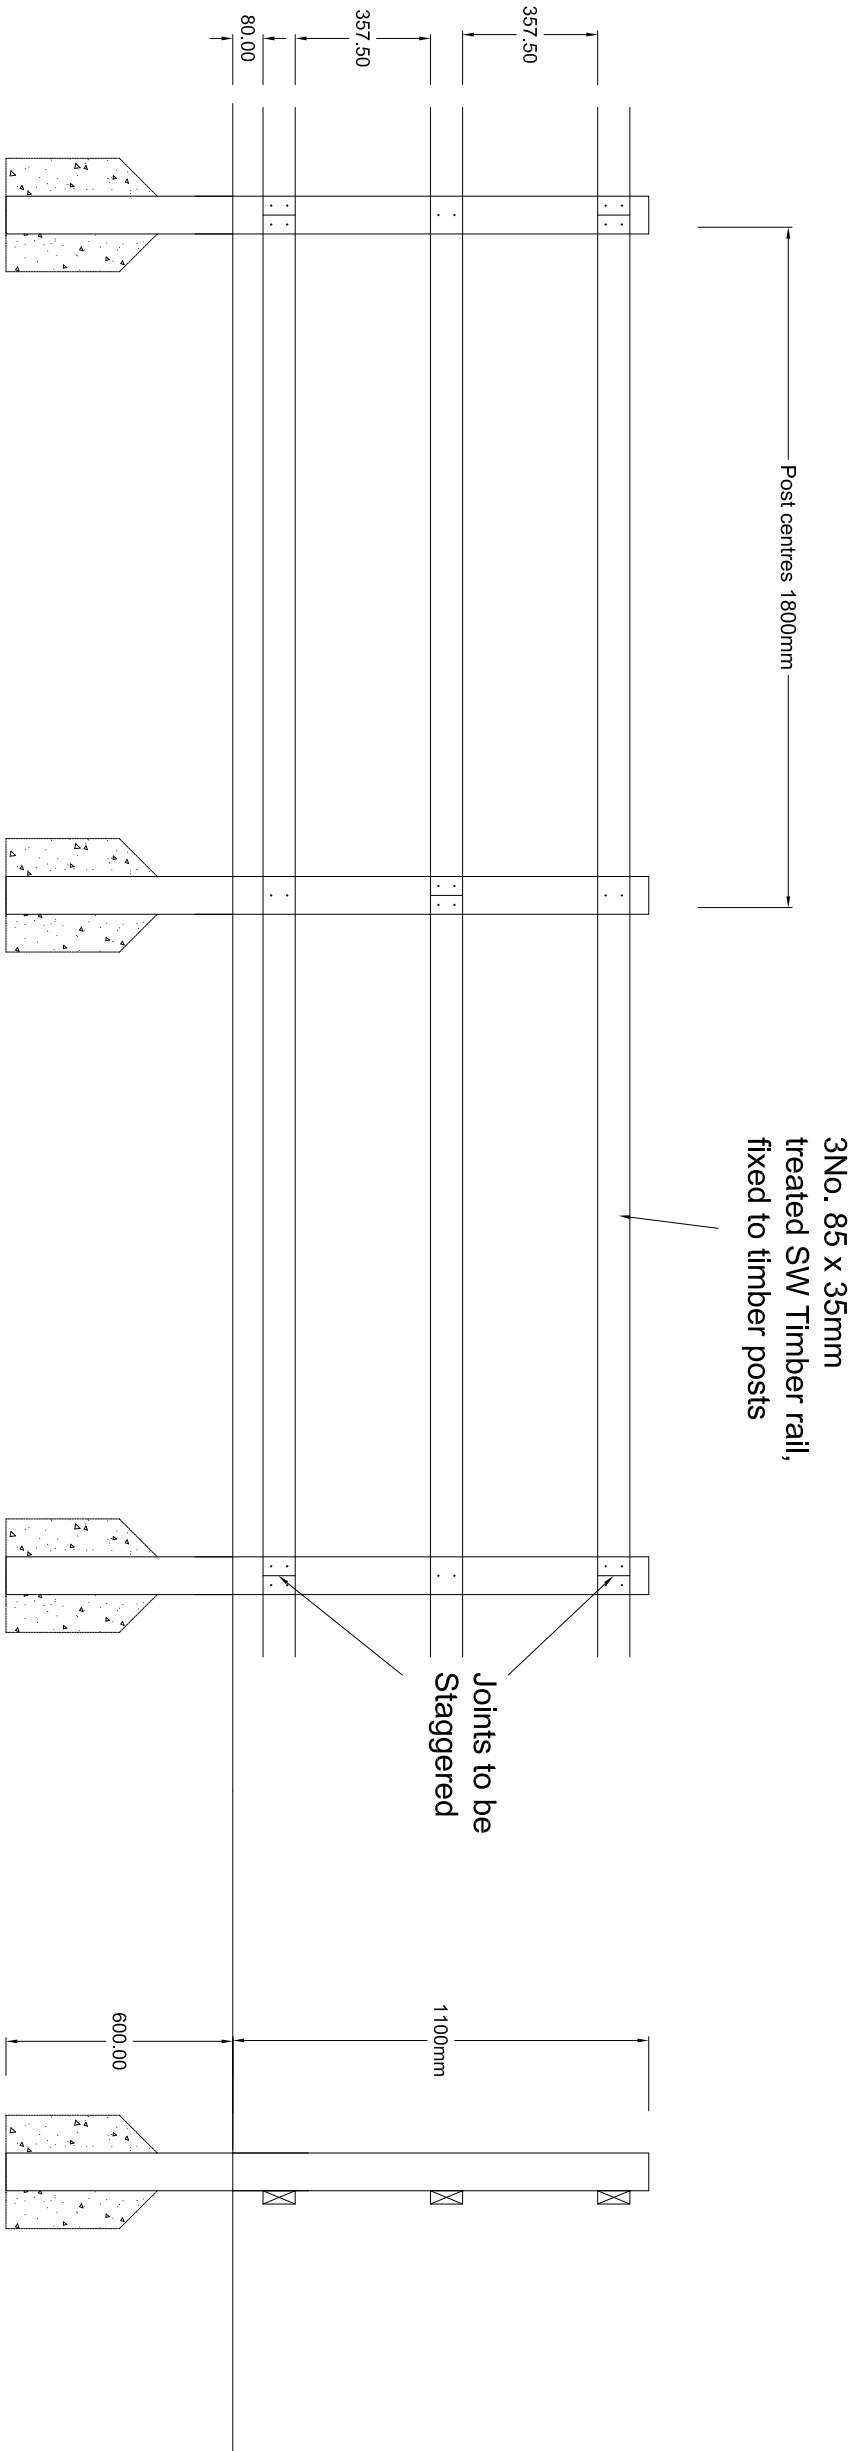




ELEVATION

SECTION

Specification

General

All components of the fencing are to be in accordance with the details and recommendations of B.S. 1722 Part 7 to which reference is made. The following is a brief synopsis of the content of the standard :-

Posts



Timber posts are to be 100mm diameter.
Posts are to be set at 1800mm centers measured center to center of posts and are to be set in the ground to a depth of 600mm.

Preservative Treatment

Timber shall be treated in accordance with the requirements for fencing timber B.S. 5589 to give a category B (20 year) service life.

Rails

Rails should have a section of 38mm x 87mm
Fixed to the Posts using 2No. 4mm x 100mm galvanised steel nails, at each post.

 Charles Church		 PERSIMMON HOMES	
Group Core Housetypes			
Superstructure Detail			
1.2m Post & 3 Rail Fence			
Drawing Number PHNW-F-05		Date 22.05.19	
		Scale 1/20@A3	
		rev	